LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/16/2009 Expiration Date: 10/17/2010

Property Owner: David Lehenky c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Koocanusa Plumbing & Electric License No. 8

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Wastewater holding tank system for Performance Binaries operation. ***Use of this system for disposal of residential wastewater is strictly prohibited. Use of this system by any other commercial operation without prior review and approval of a "change of use" proposal by the Department is prohibited. Tank must be leak tested annually & results reported to the Department.***

Parcel Description:

Legal: SW-1/4 SE-1/4 S7 T35 R27

Address or Location: Performance Binaries, LLC – 2409 Black Lake Road

Approved Design Criteria:

Max. Discharge: 250 Callons per Production Run Holding Tank Size: 1000 gallons

Minimum Pumping Schedule: Following every third production run (sooner in the event tank alarm is activated).

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL WASTEWATER HOLDING TANK SYSTEM ACCORDING TO LOT LAYOUT, CIRCULAR DEQ-4 CHAPTER 24 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

NE 1/4 NW 1/4 Section 21
Twp 36 N Rge 27 W
Lincoln County

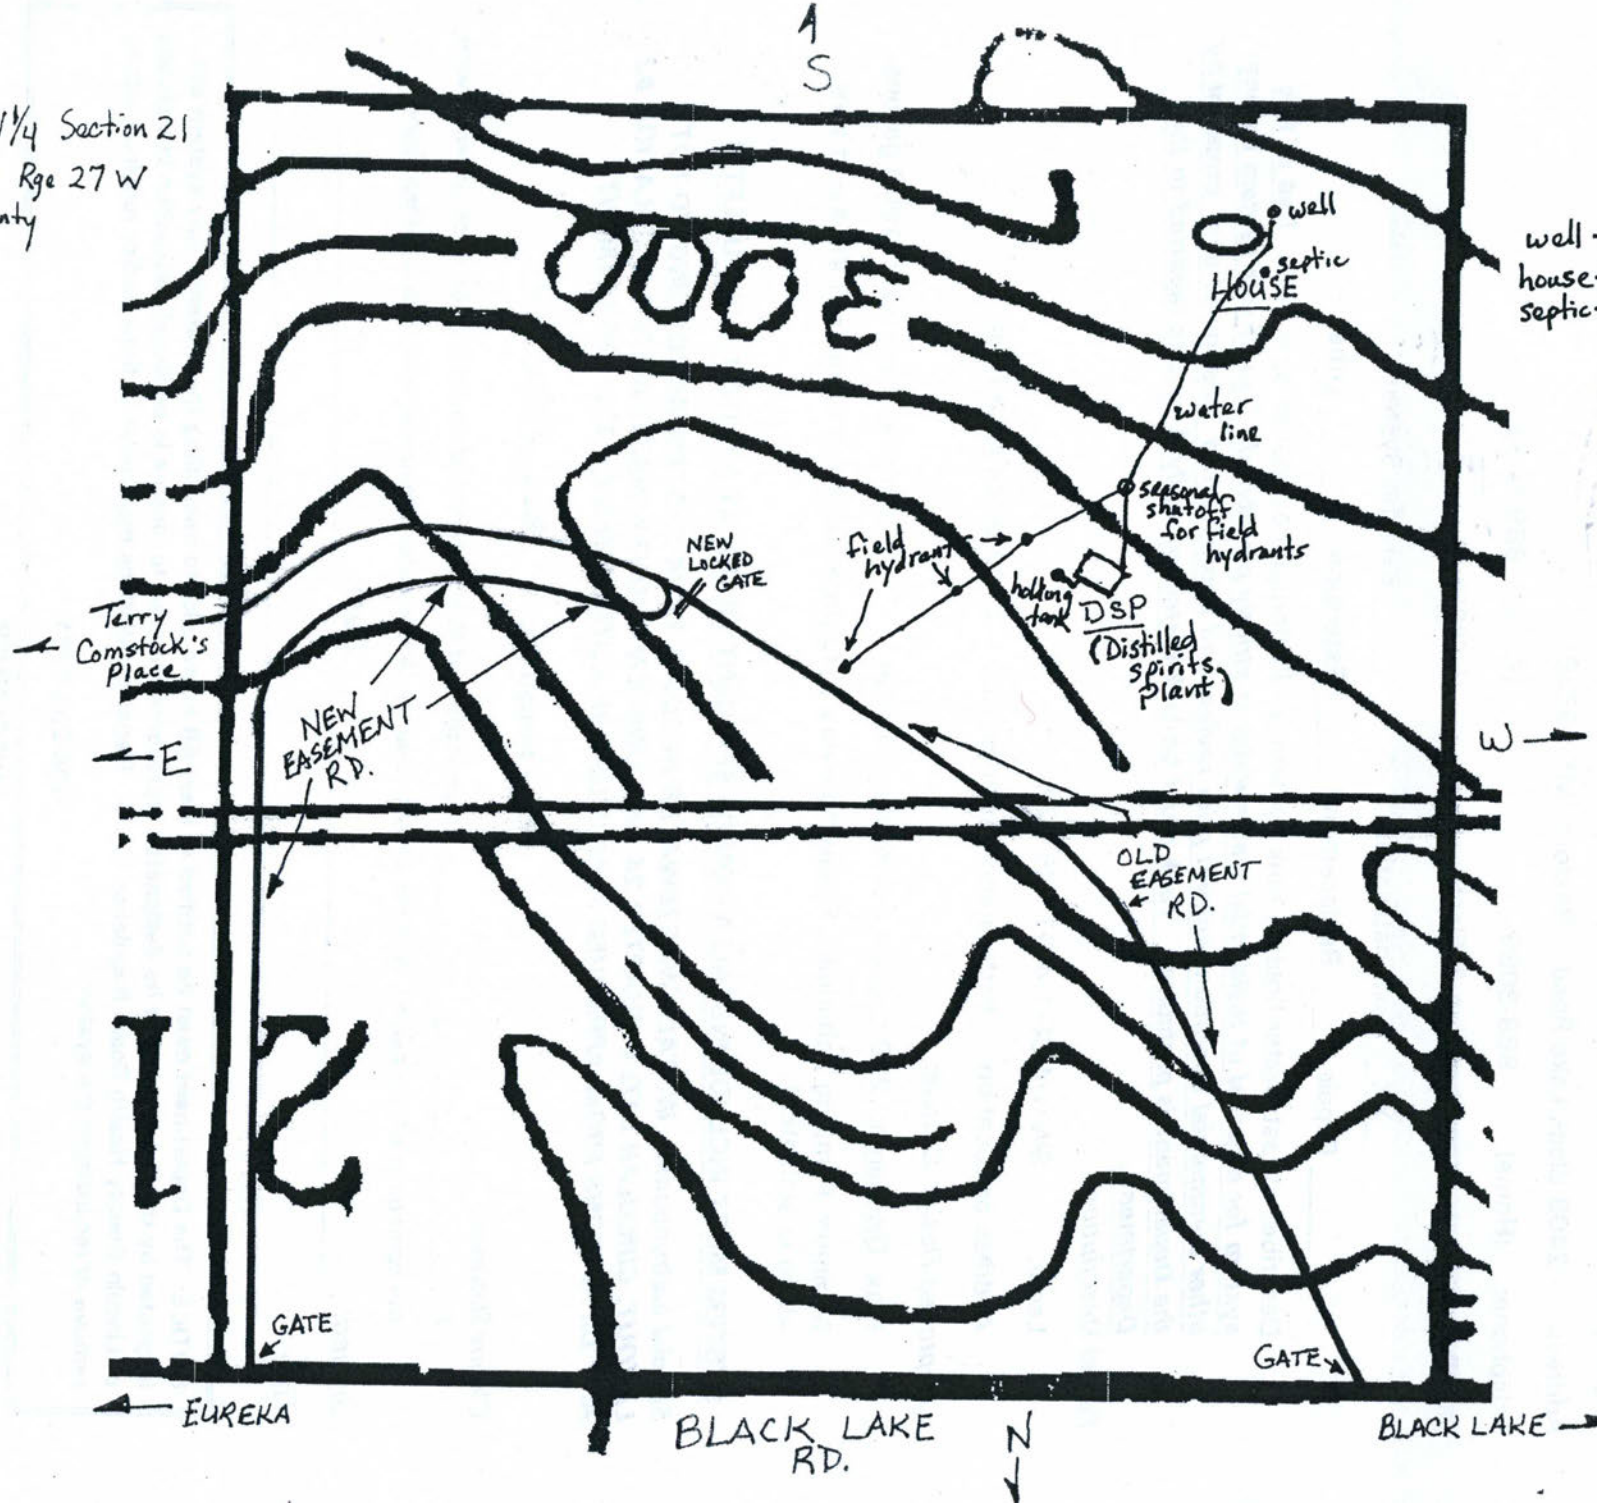

well → house = 70'
house → septic = 80'
septic → DSP = 450'