LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/02/2009 Expiration Date: 11/03/2010

Property Owner: Al Liekhus c/o: Glen Larson

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Glen Larson License No. 66

____ New Installation __XX__ Existing System

_____ Repair __XX__ Replacement_____ Extension _____ Other

Describe: Replacing un-used existing system to alleviate encroachment on home site. Installing gravelless chambers – 25% sizing reduction allowed per "Drainfield Size" indicated below.

Parcel Description:

Legal: S-1/2 SE-1/4 S15 T36 R28

Address or Location: Lot 27 of Pine Bay #2

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 108 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

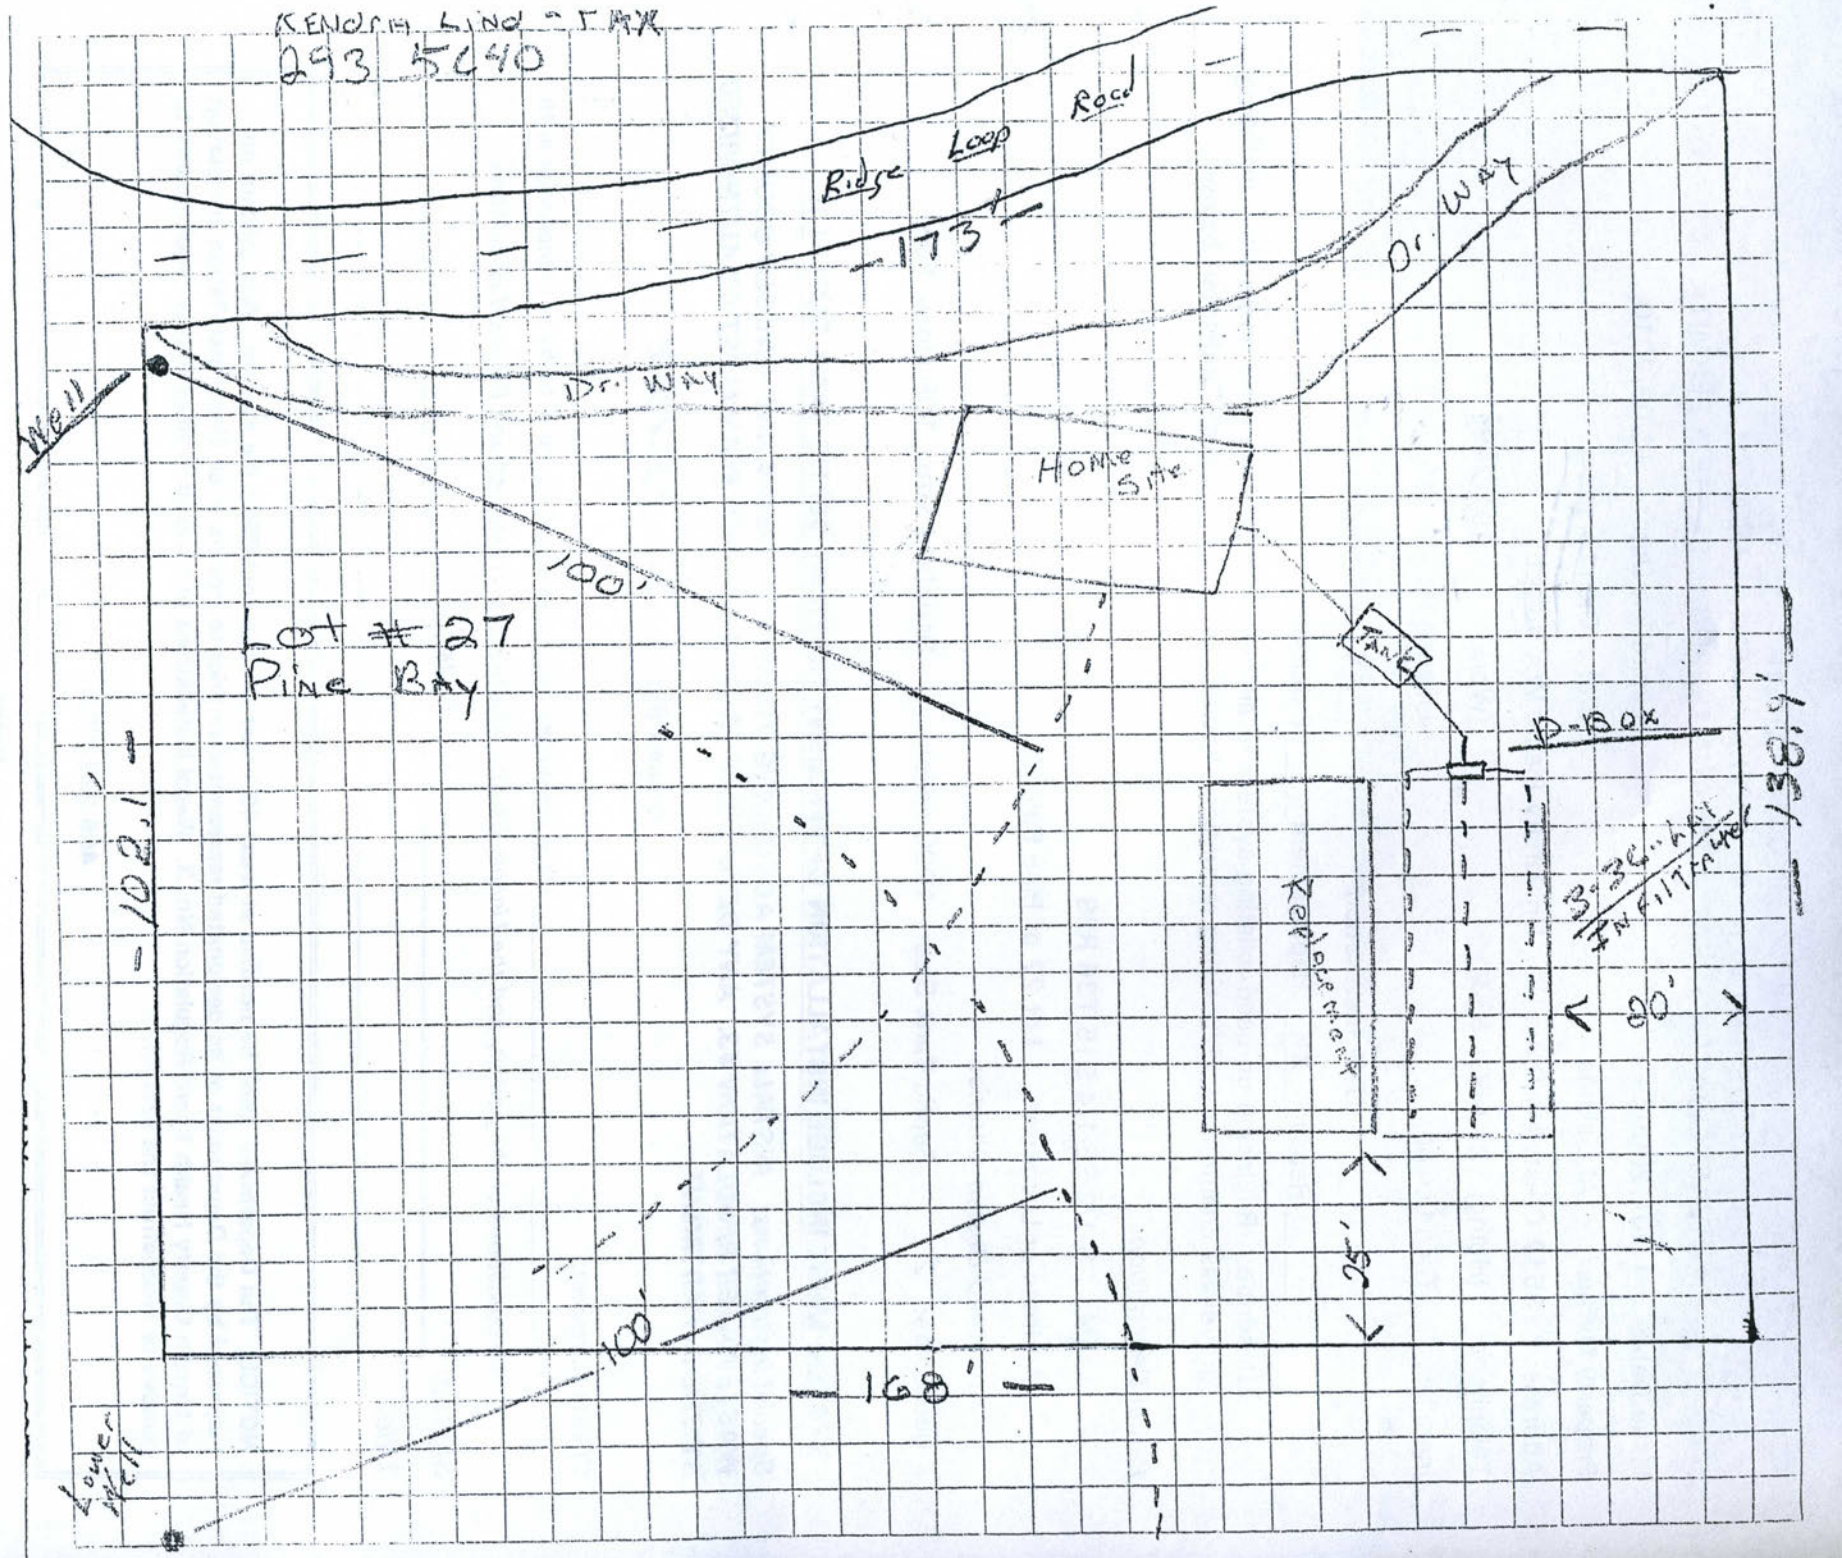
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


RENOVATE EXISTING TANK
293 5040
Ridge Loop Road
173'
Dr. WAY
Well
Dr. WAY
HOME SITE
100'
Lot # 27
Pine Bay
TANK
P-BOX
102.1'
130.4'
3-36" HDPE INFILTRATOR
80'
Retaining Wall
25'
100'
168'
Lower Lot