LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

File

Issue Date: 07/18/06 Expiration Date: 07/17/07

Property Owner: Elvie Miller c/o: Benjamin Girod

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: BK Construction License No. 75

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe:

Parcel Description:

Legal: S36 T30 R31

Address or Location: Evans Tracts Lot 5

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 140 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

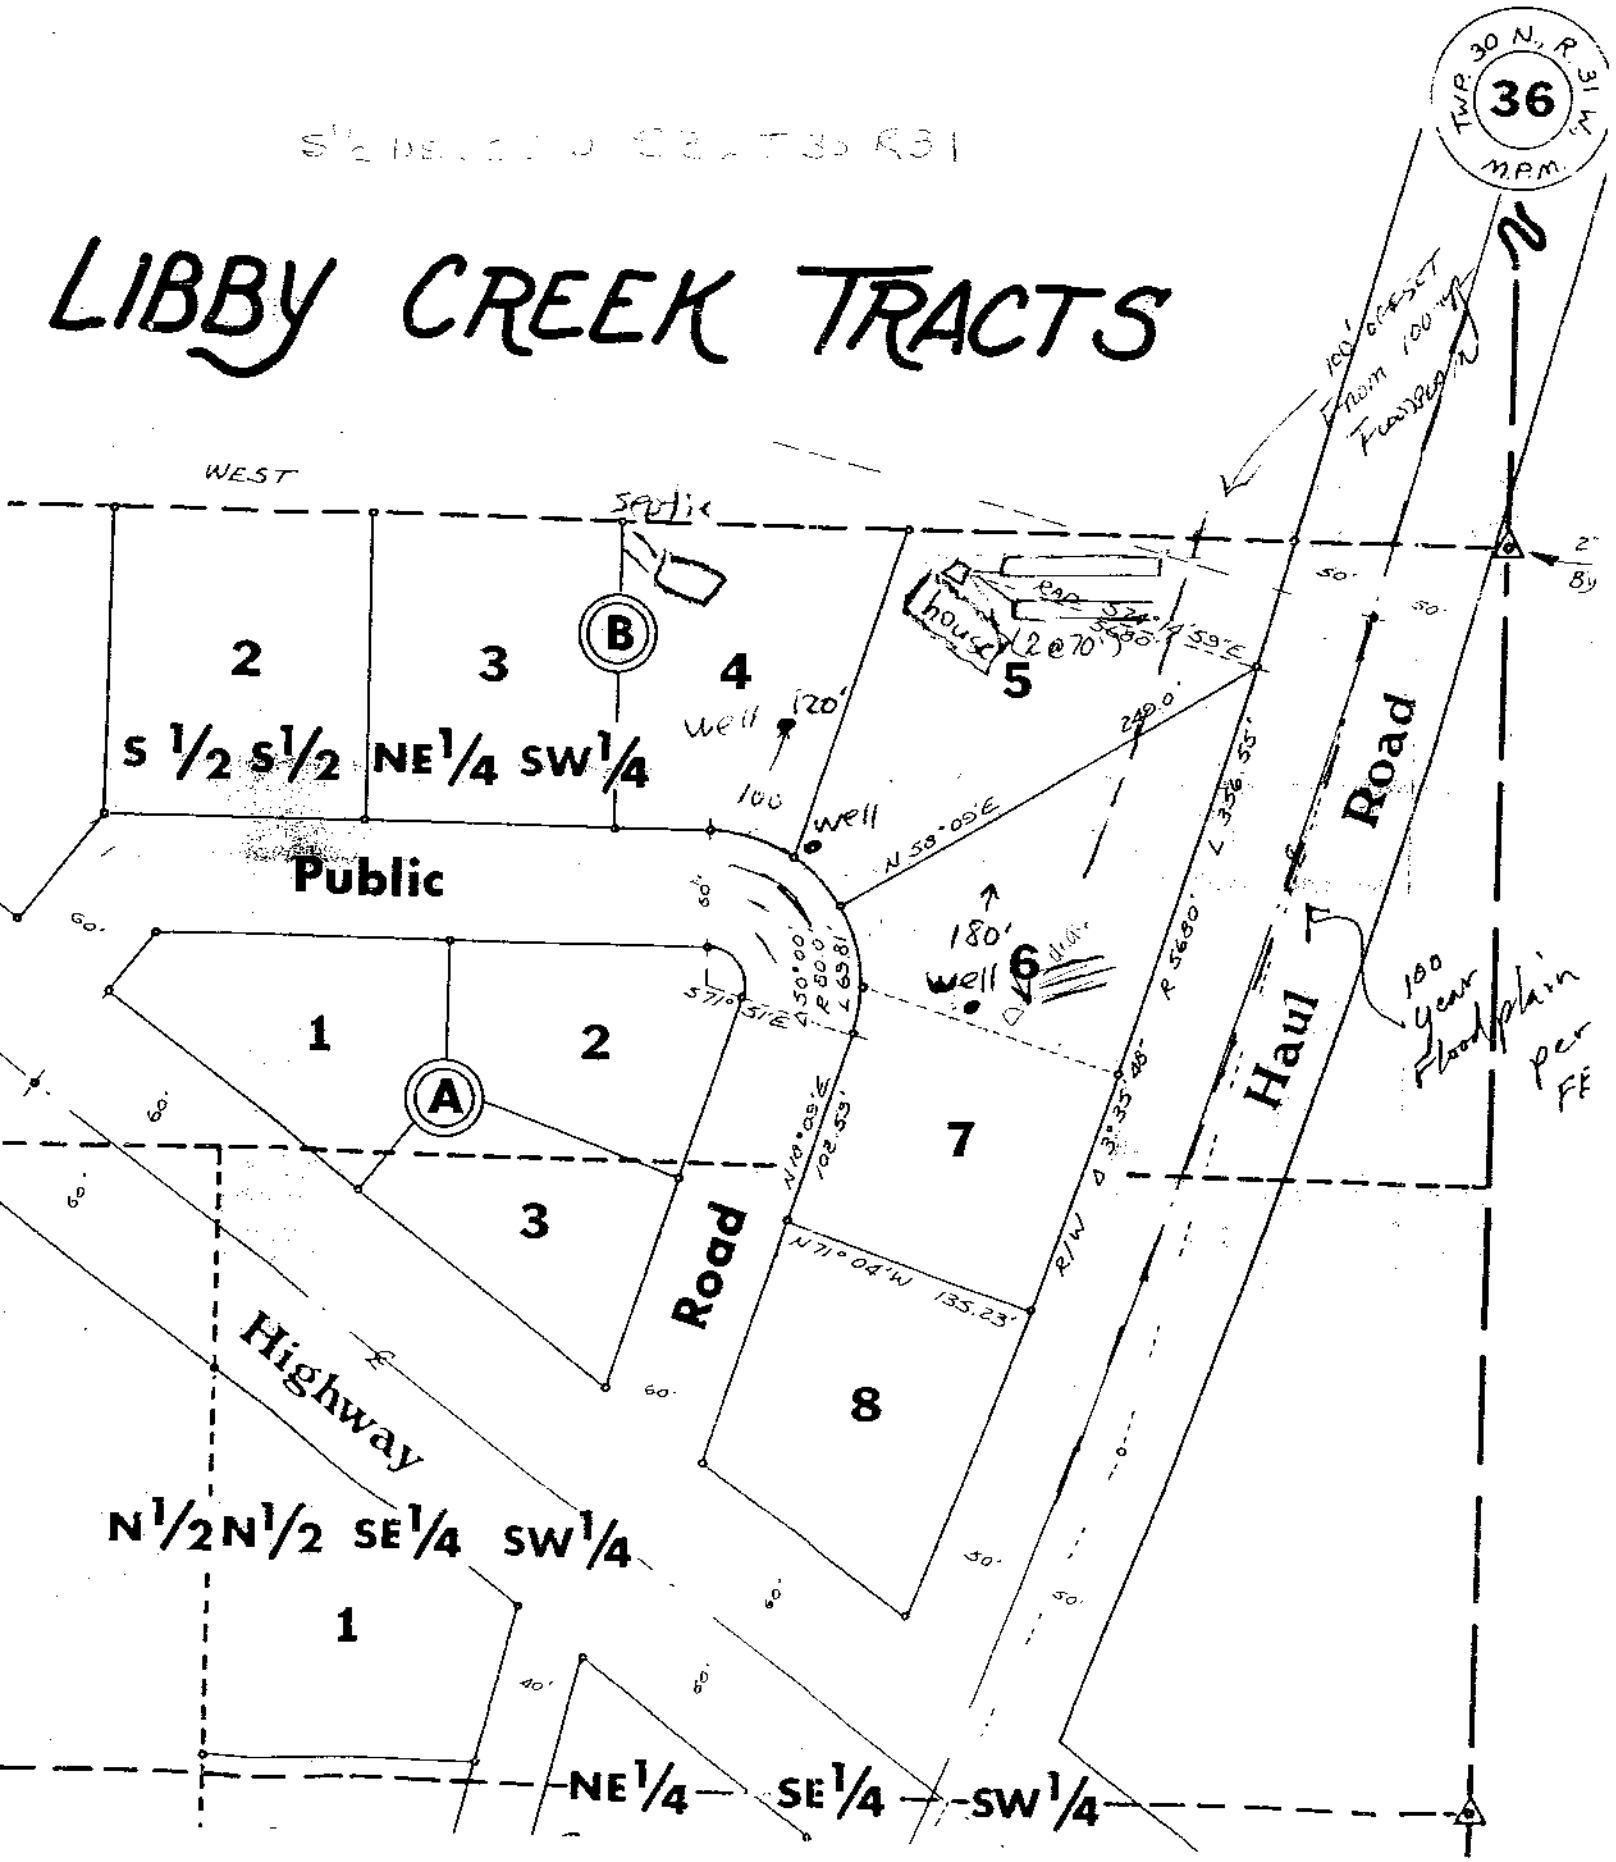
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


S½ Sec. 1 & Sec. 36 T30 R31
LIBBY CREEK TRACTS
TWP. 30 N., R. 31 W., M.P.M.
36
WEST
septic
2
S ½ S ½
3
NE¼ SW¼
B
4
well
120'
100
5
house
(2@70')
well
N 58-05E
249.0
Public
Road
60'
1
2
A
3
60'
60'
S71°51'E
R 50.00'
L 69.81'
180'
well
6
7
N18°09'W
102.53'
N71°04'W 135.23'
8
Highway
N½N½ SE¼ SW¼
1
40'
60'
NE¼ SE¼ SW¼
100' offset
From 100' R/W
Haul Road
R 5680'
L 336.55'
Δ 3°35'48"
R/W
50'
100 year Floodplain per FE
2" By