LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/21/2009 Expiration Date: 10/22/2010

Property Owner: Wayne Sibbons c/o: Koocanusa Plumbing & Electric

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing & Electric License No. 8

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Pressure-dosed system per DEQ approval statement E.Q. #06-3180

Parcel Description:

Legal: NW-1/4 S27 & E-1/2 S28 T36 R26

Address or Location: Lot 32 of Glen Lake Hills

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 252 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL PRESSURE-DOSED SYSTEM ACCORDING TO DEQ APPROVAL, LOT LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

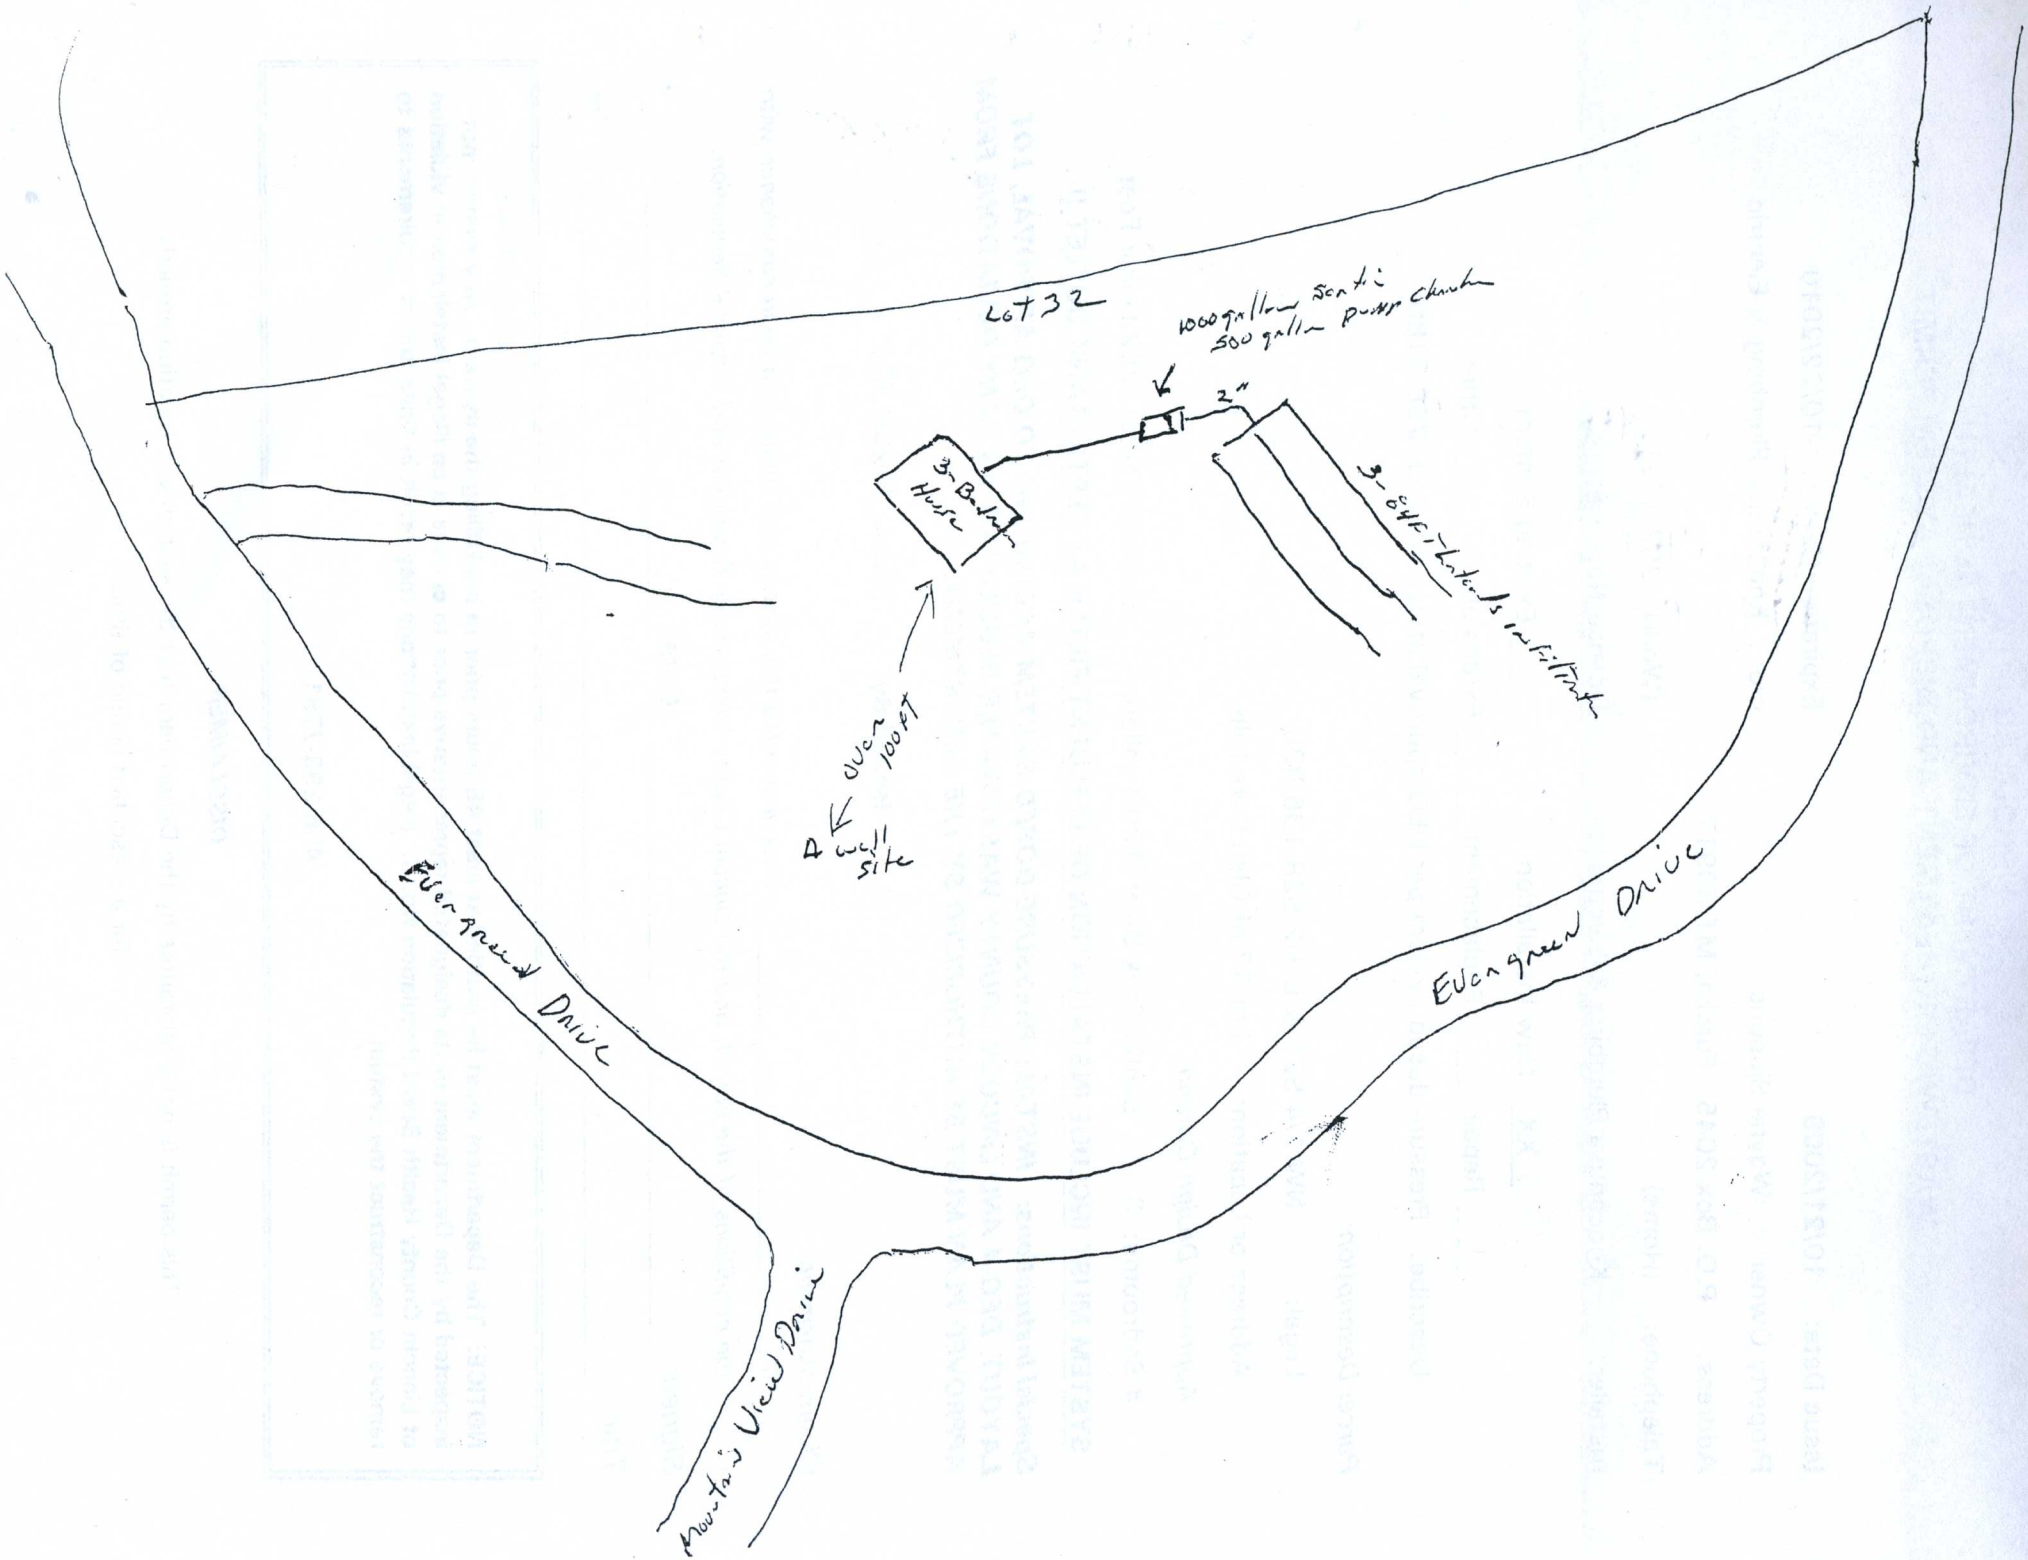
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lot 32
1000 gallon Septic
500 gallon pump chamber
2"
3 Bedroom House
3 - 6'x6' Lateral infiltrators
Well 100 ft
Well Site
Evergreen Drive
Evergreen Drive
Mountain View Drive