# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/18/2009 Expiration Date: 09/19/2010

Property Owner: Thomas Trani c/o: Koocanusa Plumbing & Electric

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing & Electric License No. 8

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers. "Drainfield Size" below reflects 25% sizing reduction allowed.

*Parcel Description*:

Legal: Lot 16 in Gateway Village Unit 4

Address or Location:

*Approved Design Criteria*:

# Bedrooms: 5 Septic Tank Size: 2000 gallons Drainfield Size: 192 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** *Kendra J. Lind, R.S.*

*Closure Statement:*

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* _____

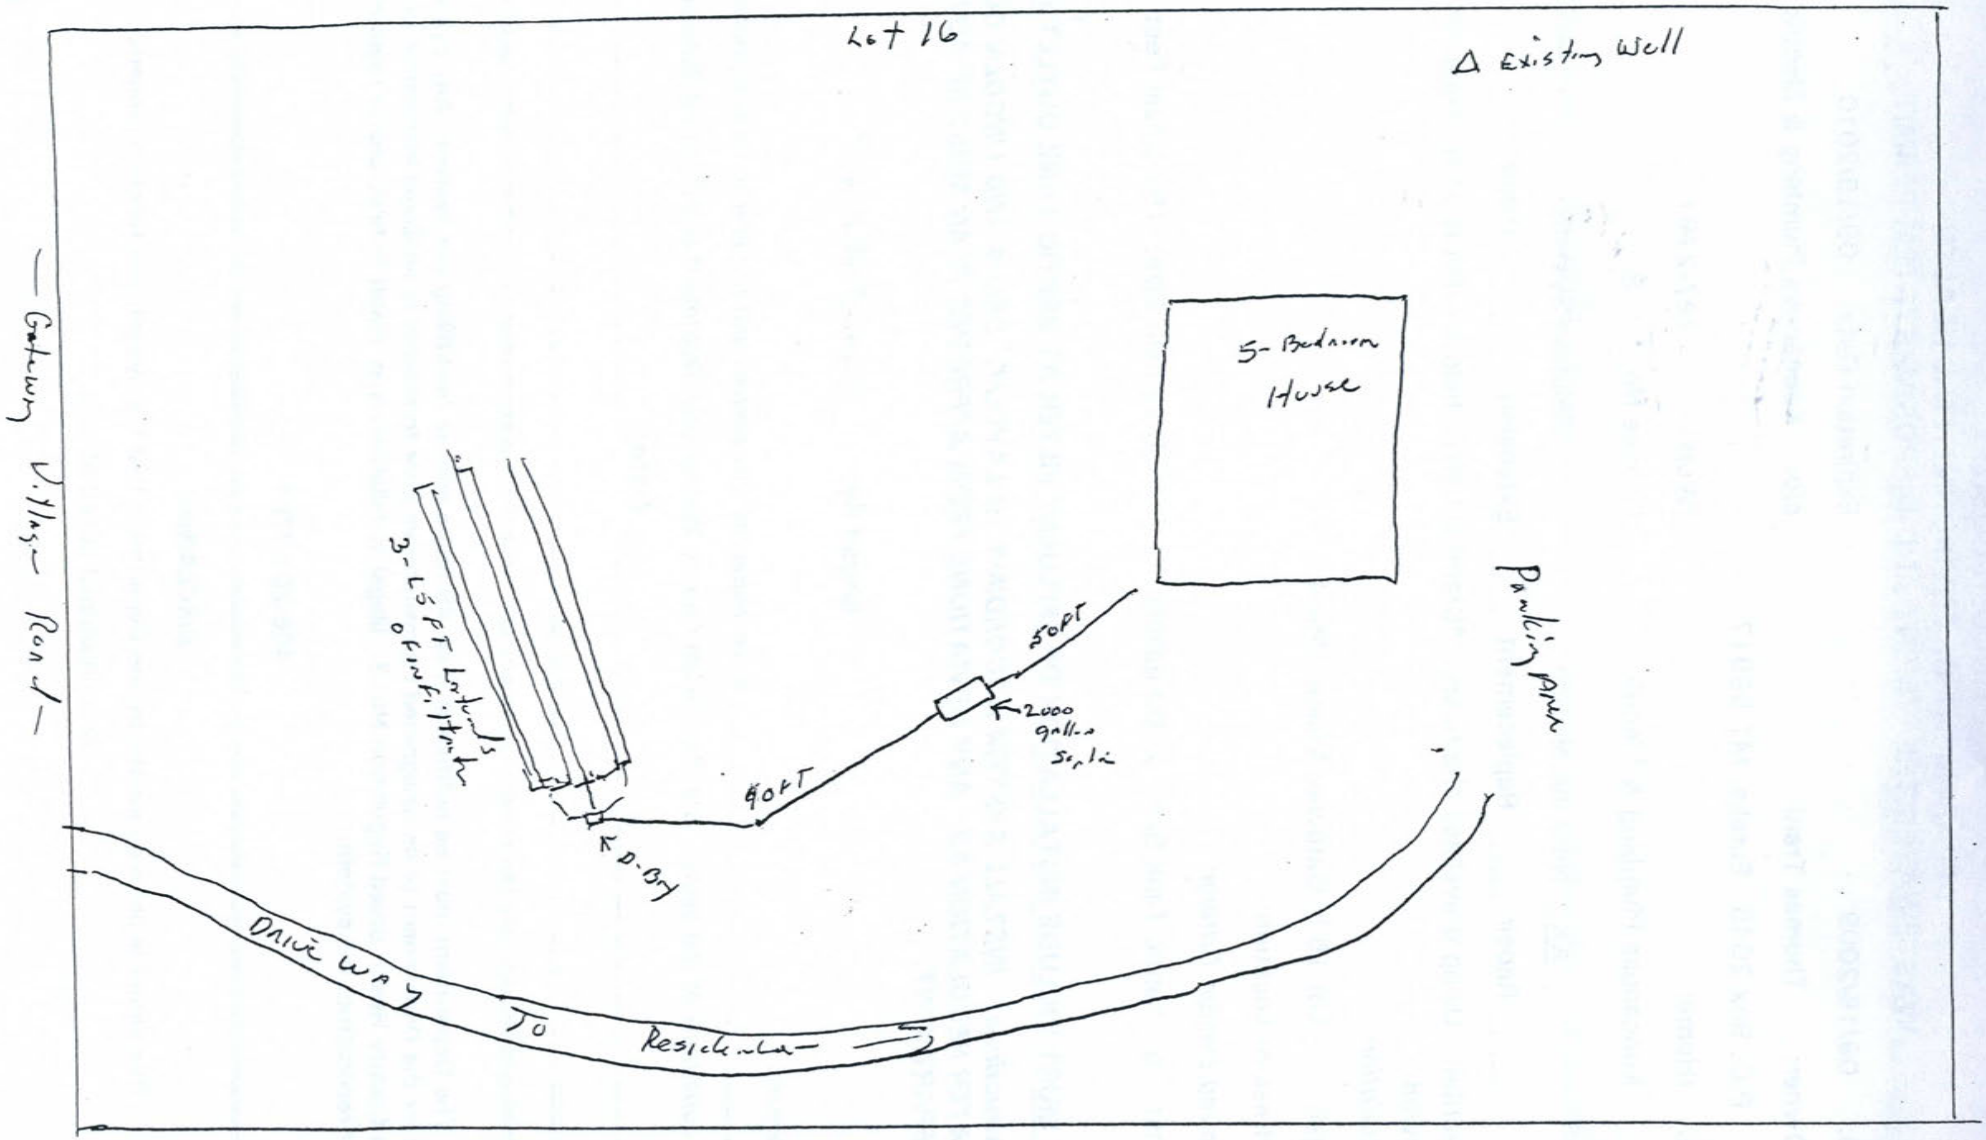
*Title:* _____

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-293-7781**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lot 16
Δ Existing Well
5- Bedroom House
Parking Area
50FT
2000 gallon Septic
40FT
3- 45FT Leachfields of infiltrators
10FT
DRIVE WAY
To Residence
Gateway Village Road