LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/23/2026 Expiration Date: 04/22/2027 Permit#26-55363

Property Owner: Marty Whitmore

Mailing Address: [redacted]

Installer: Sean McNamara License #: 221

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Parcel Description:

Legal: EUREKA HILLS PH 2, S26, T36 N, R27 W, LOT 36, ACRES 3.866, PM 6904

Property Address: 520 Riding High Dr., Eureka, MT 59917 Assessment Code: 55363

DEQ COSA: E.Q.#07-2095 Eureka Hills Subdivision Date: 9/28/07

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 4 Laterals @ 84'.

# of Bedrooms: 3 Septic Tank Size: 1500/500 gallons Trench Width: 36"

# of Laterals: 4 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

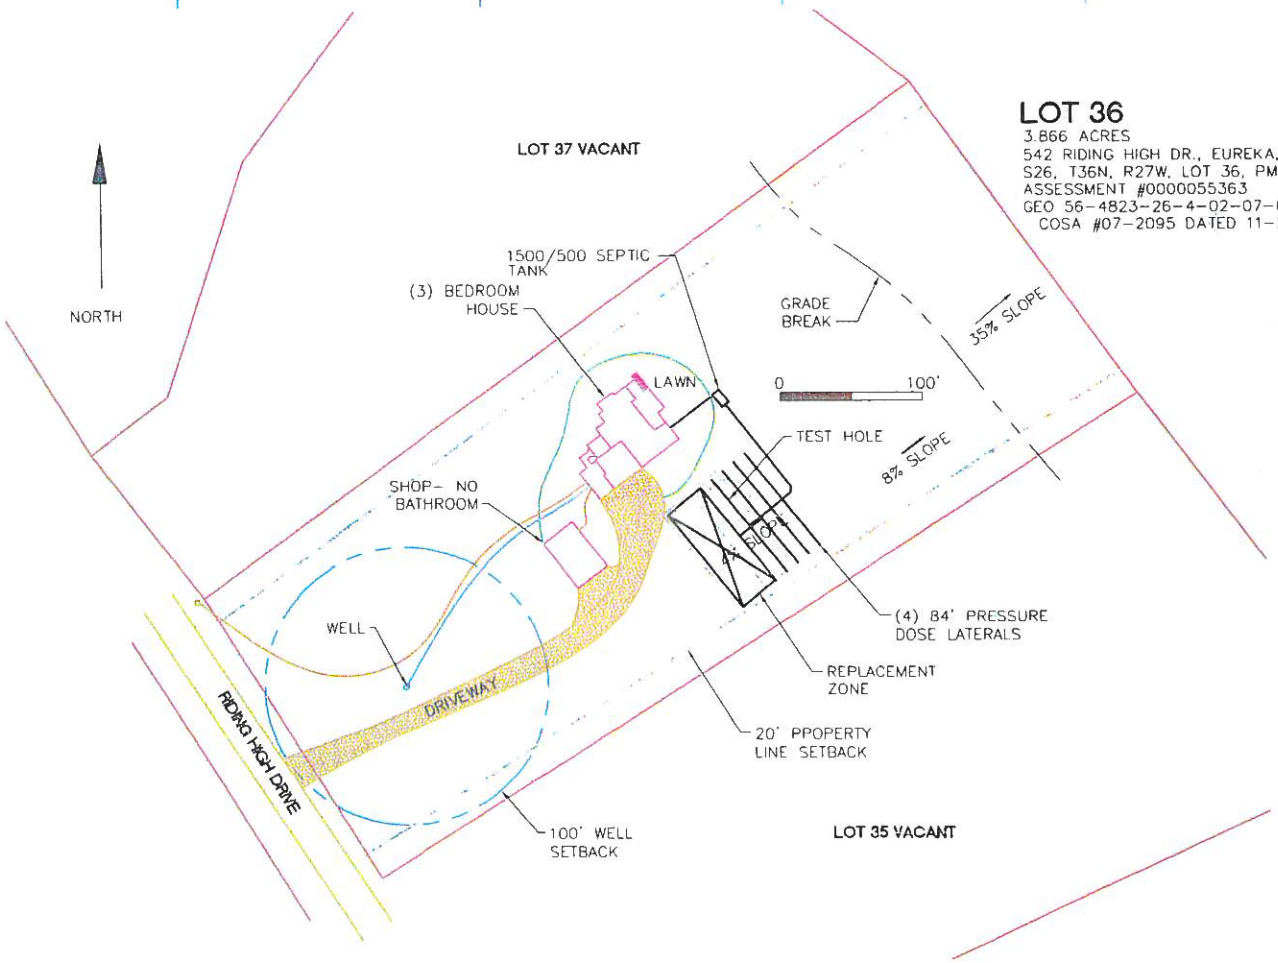

LOT 36

3.866 ACRES
542 RIDING HIGH DR., EUREKA, MT 59917
S26, T36N, R27W, LOT 36, PM 6904
ASSESSMENT #0000055363
GEO 56-4823-26-4-02-07-0000
COSA #07-2095 DATED 11-2007

DRAINFIELD SIZING-PRESSURE

(3) BEDROOM= 300 GPD
300 GPD/0.3 APP= 1000 SQFT
1000 SQ FT/3' CHAMBERS= 334 LF
334 LF/ 4 LATERALS= 84'

WHITMORE SITE MAP

REV	DESCRIPTION	BY/DATE	APPD/DATE

REV	DATE	COMPANY	SCALE	KOOCANUSA EXCAVATING WHITMORE SEPTIC
		KEI	1/16 = NOTED	SITE LAYOUT
		CONTRACT	DATE	
		VERBAL	9/2024	
		PLOT FILE	WEIGHT	S. MCNAMARA 9/27/24
		PML-0001		365-001 1

THIS DRAWING IS PROPERTY OF KEI UNLESS CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT