LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/28/2026 Expiration Date: 07/27/2027 Permit#26-13754

Property Owner: Jeffrey and Marie Garvin

Mailing Address: [redacted]

Installer: Terry Oedewaldt License #: 2

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of pump to Gravity system for 3 Bedroom House.

Legal: CEDAR GLEN ESTATES PH 2, S35, T32 N, R34 W, LOT 11, ACRES 2

Property Address: 1160 Hunts Mill Rd., Troy, MT 59935 Assessment Code: 13754

DEQ COSA: E.Q.# 00-2047 Cedar Glen Re-Review Lot 11 Date: 2/25/2000

Approved Design Criteria: Installation of pump to Gravity system for 3 Bedroom House with 3 Laterals @ 70' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000/500 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 70' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:*_____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

RE-REVIEW OF CEDAR GLEN ESTATES
LOT #11


FOR

KEN CAMPBELL

SW1/4 SE1/4 S35 T32N R34W

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Tim Read 4-19-2000
Reviewer Date

RECEIVED
OFFICE
APR 6 2000
MT DEPT OF ENV QUALITY
PERMITTING & COMPLIANCE DIV

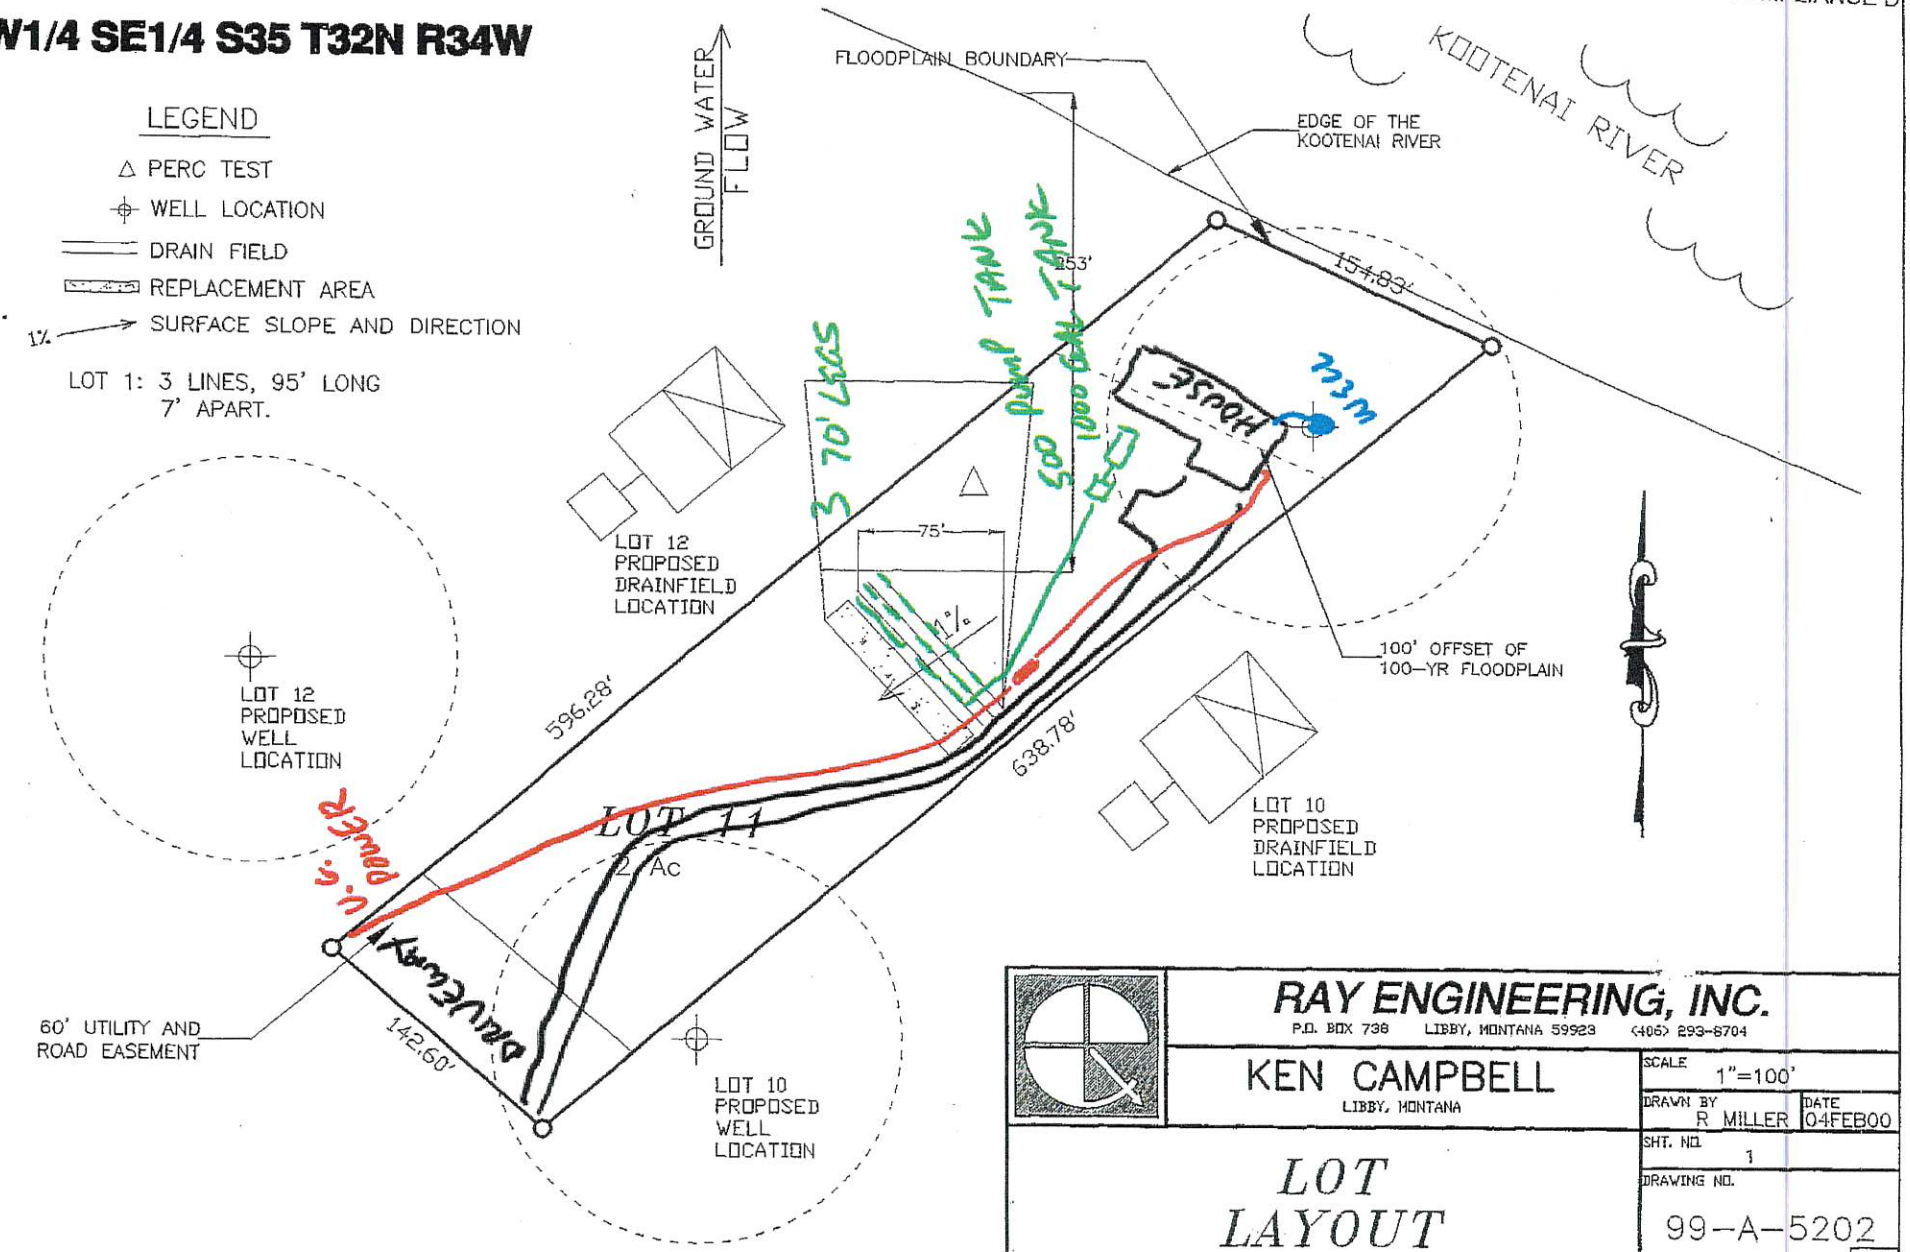

RAY ENGINEERING, INC.
P.O. BOX 738 LIBBY, MONTANA 59923 (406) 293-8704

KEN CAMPBELL
LIBBY, MONTANA

SCALE 1"=100'
DRAWN BY R MILLER
DATE 04FEB00
SHT. NO. 1
DRAWING NO. 99-A-5202
R1

LOT LAYOUT