LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/5/2026 Expiration Date: 5/4/2027 Permit# 26-8121

Property Owner: Romy Ashby

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of new gravity system to replace failing system for 2 Bedroom House.

Legal: SULLIVAN LOTS, S04, T30 N, R31 W, LOT 005, SULLIVAN LOTS 5&6

Property Address: 319 Mahoney Rd., Libby, MT 59923 Assessment Code: 8121

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system to replace failing system for 2 Bedroom House with 2 Laterals @ 50' with reduction for chambers. With connection to City of Libby water.

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Depth: 24"-36"

# of Laterals: 3 Length of Laterals: 34' Trench Width: 24"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

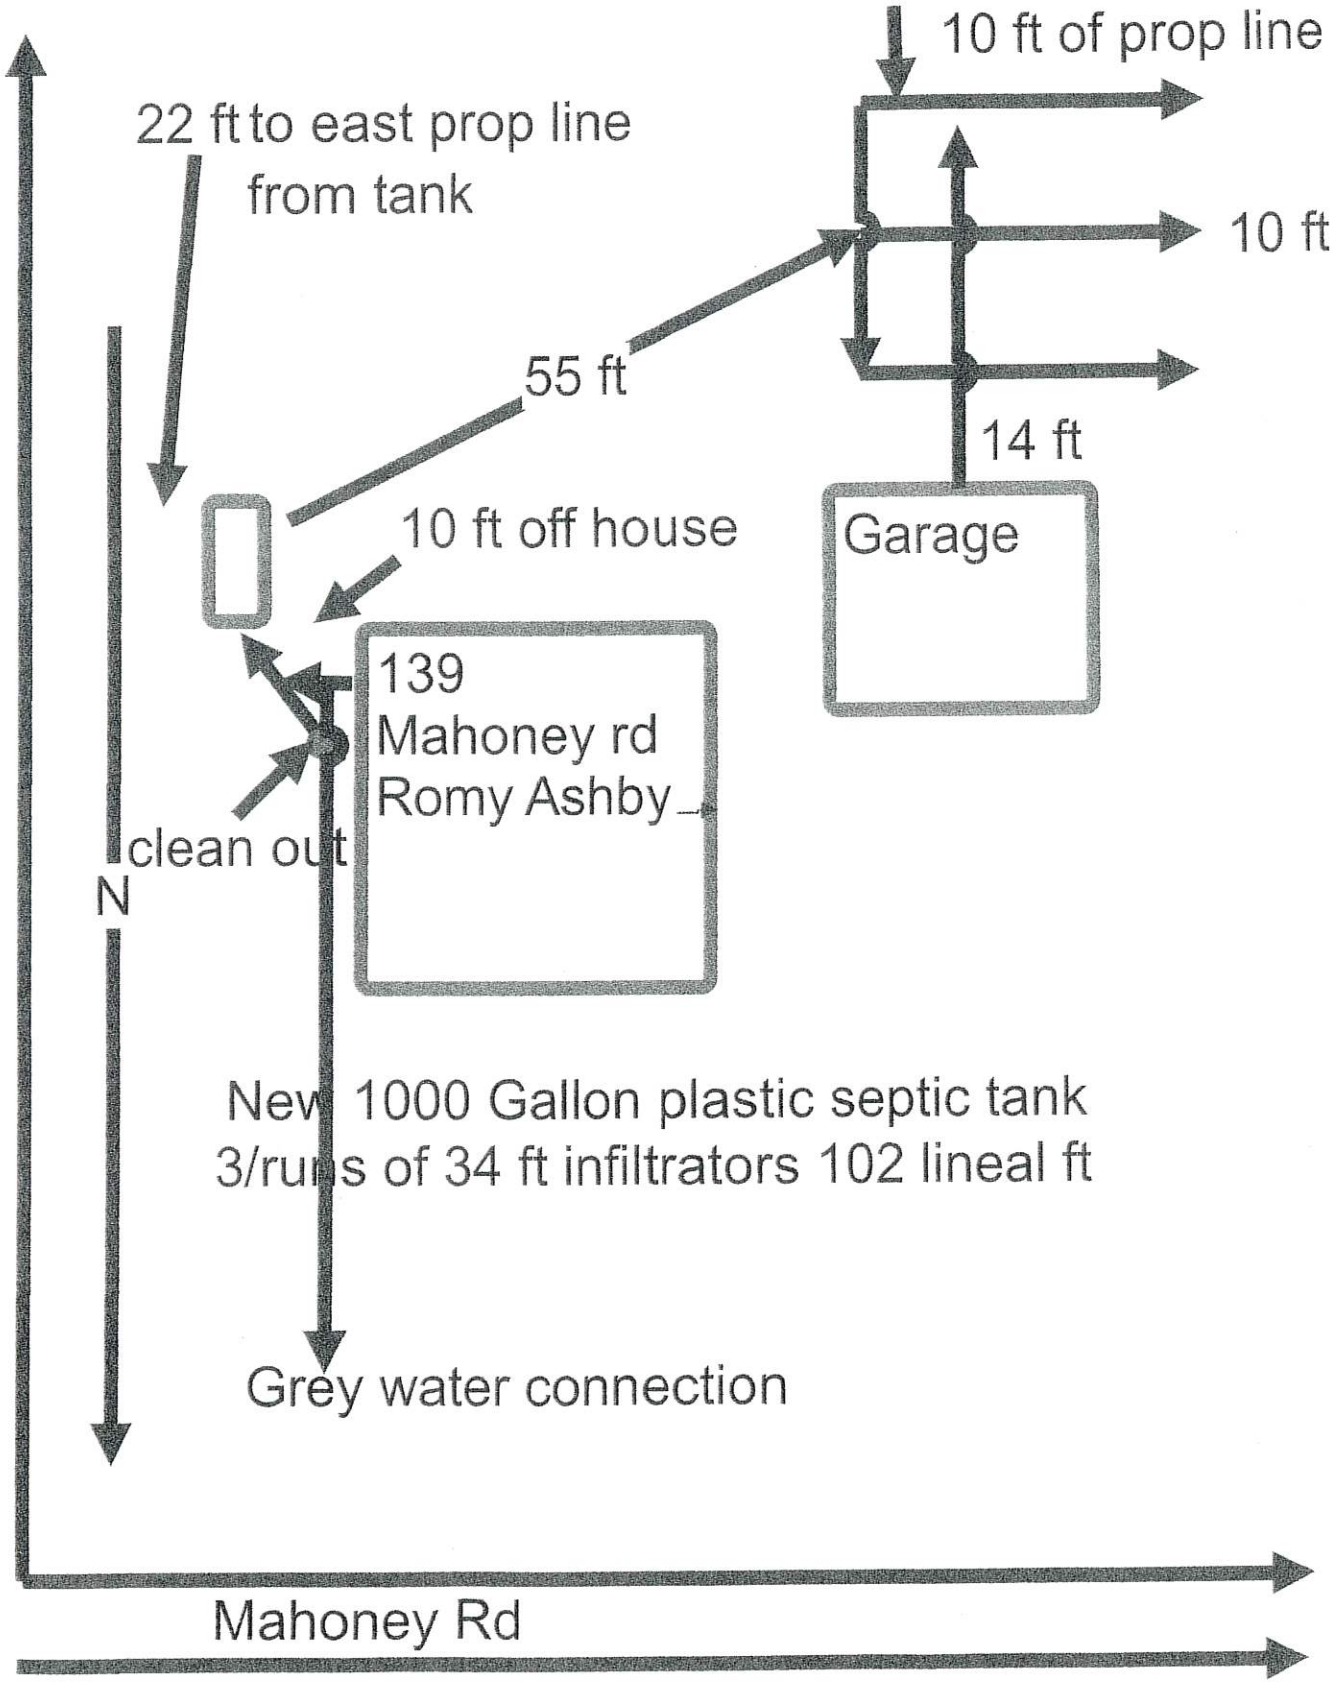
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/27/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


10 ft of prop line
22 ft to east prop line
from tank
10 ft
55 ft
14 ft
10 ft off house
Garage
139
Mahoney rd
Romy Ashby
clean out
N
New 1000 Gallon plastic septic tank
3/runs of 34 ft infiltrators 102 lineal ft
Grey water connection
Mahoney Rd