LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/17/2026 Expiration Date: 08/16/2027 Permit#26-17905 B

Property Owner: Carmen and Shan Davis

Mailing Address: [redacted]

Installer: Zayne Davis License #: 226

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of pressure dosed system for 3 Bedroom House.

Legal: MINOR 5258, S25, T37 N, R27 W, LOT 3, ACRES 3.401, PM 5258

Property Address: 45 Wards Crescent Rd., Eureka, MT 59917 Assessment Code: 17905

DEQ COSA: E.Q.#25-2204 Iwanicha Minor Date: 6/3/26

Approved Design Criteria: Installation of pressure dosed system for 3 Bedroom House with 2 Laterals @ 65'.

# of Bedrooms: 3 Septic Tank Size:1000/500 gallons Trench Width: 36"

# of Laterals: 2 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____


This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

ALL WASTEWATER COLLECTION PIPES SHALL BE INSTALLED @ A UNIFORM SLOPE

ALL WASTEWATER FORCEMAINS SHALL BE INSTALLED AT A DEPTH OF 6' OR INSULATED

ALL SEPTIC COMPONENTS (WITH THE EXCEPTION OF DRAINFIELDS) MUST HAVE 48" COVER OR BE INSULATED TO PREVENT FREEZING)

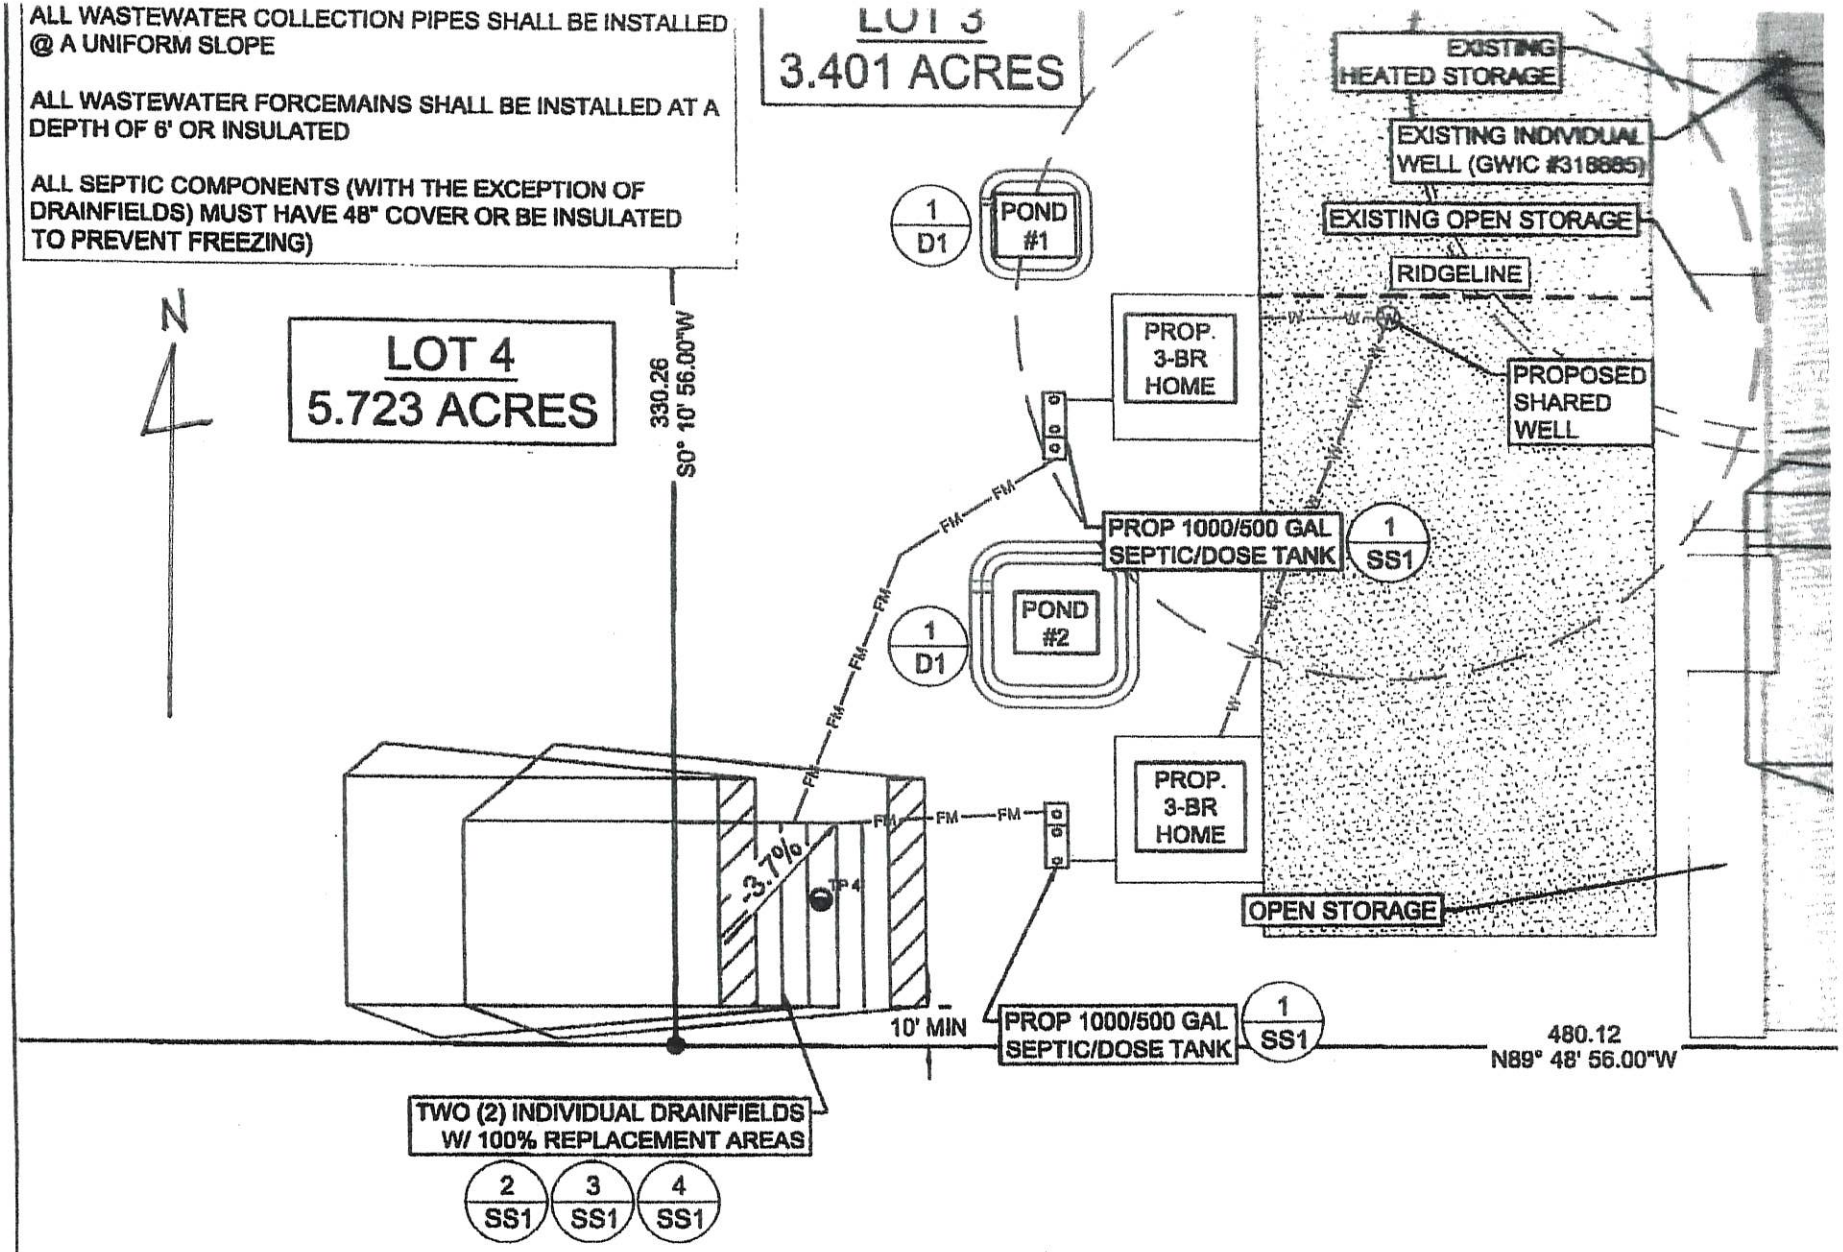

NOTE:

THERE ARE NO DESIGNATED FLOODPLAINS WITHIN 100' OF THIS PROJECT

EASEMENT NOTES:

DRAWINGS BY CASNE & ASSOCIATES, INC. DO NOT DEPICT LEGAL AND RECORDED EASEMENTS. SUCH EASEMENTS CAN BE FOUND ON THE PROPER LEGAL AND RECORDED DOCUMENT(S) WHICH MAY INCLUDE FINAL PLATS, CERTIFICATES OF SURVEY, SPECIFIC BOOKS AND PAGE NUMBERS AT THE COUNTY CLERK AND RECORDER'S OFFICE, ETC.