LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/13/2026 (Renewal) 07/23/2025 Expiration Date: 08/12/2027 Permit#25-52494

Property Owner: Charles Enlow and Lisa Rose

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: S32, T30 N, R33 W, COS PM 6672, PARCEL A, ACRES 20

Property Address: 357 Troy Mine Rd., Troy, MT 59935 Assessment Code: 52494

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 2 Laterals @ 50' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 2 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: **The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

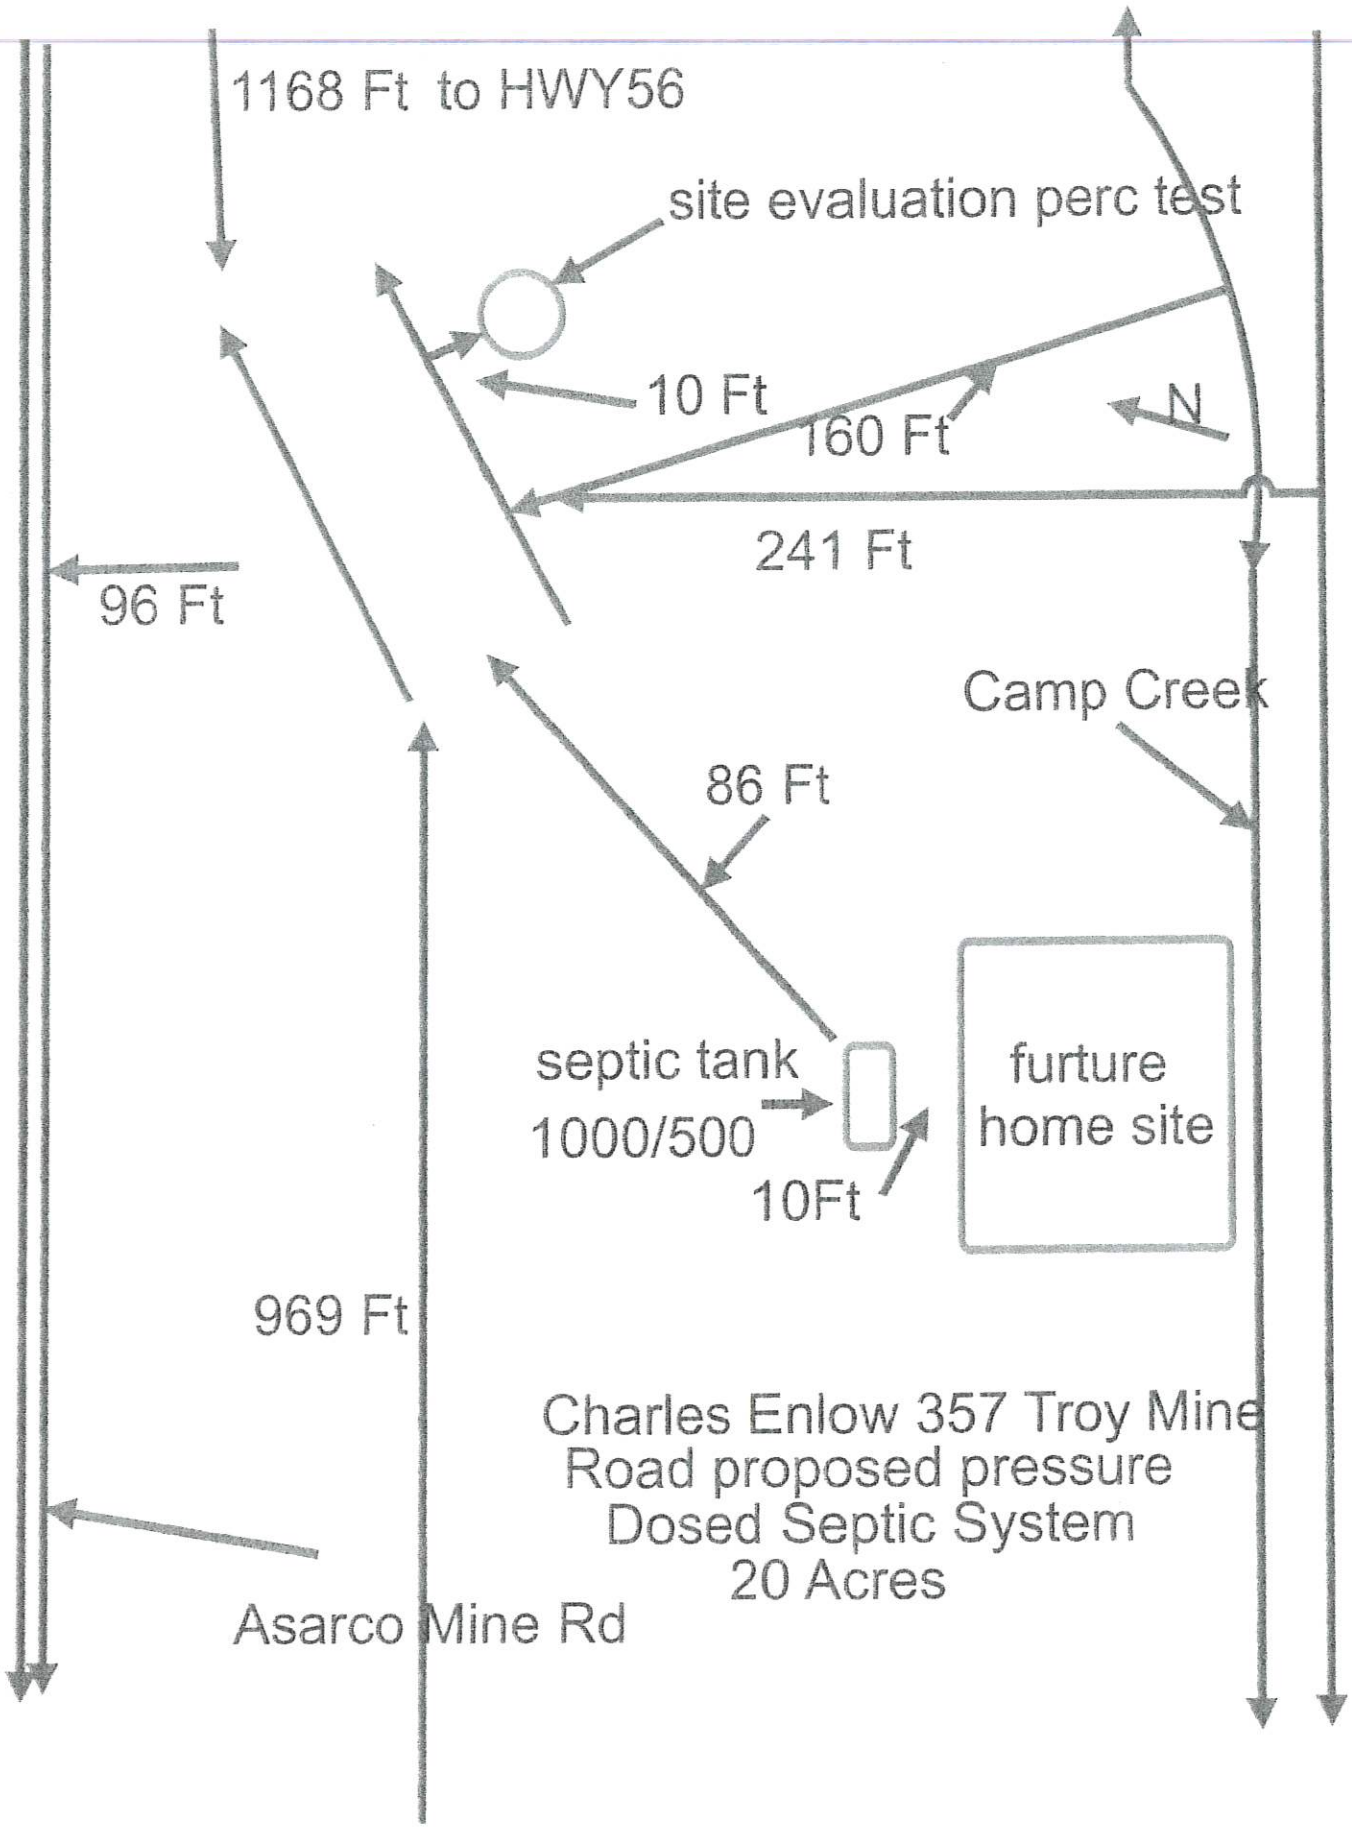
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:*_____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


1168 Ft to HWY56
site evaluation perc test
10 Ft
160 Ft
N
241 Ft
96 Ft
Camp Creek
86 Ft
septic tank
1000/500
10Ft
furture
home site
969 Ft
Charles Enlow 357 Troy Mine
Road proposed pressure
Dosed Septic System
20 Acres
Asarco Mine Rd