LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/10/2026 Expiration Date: 07/09/2027 Permit# 26-14806

Property Owner: Jacob Jost

Mailing Address: [redacted]

Installer: Sean McNamara License #: 221

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Installation of gravity system for 4 Bedroom House to replace failing system.

Parcel Description:

Legal: MILLS SPRING, S11, T36 N, R27 W, LOT 1A, ACRES 1.118, PM 4704

Property Address: 125 Spring Ln., Eureka, MT 59917 Assessment Code: 14806

DEQ COSA: EQ#27-91-S11-231 Date: 12/12/90

Approved Design Criteria: Installation of gravity system for 4 Bedroom House to replace failing system with 4 Laterals @ 50' with reduction for chambers.

# of Bedrooms: 4 Septic Tank Size:1500 Trench Width: 24"

# of Laterals: 4 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg *Date:* 7/30/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

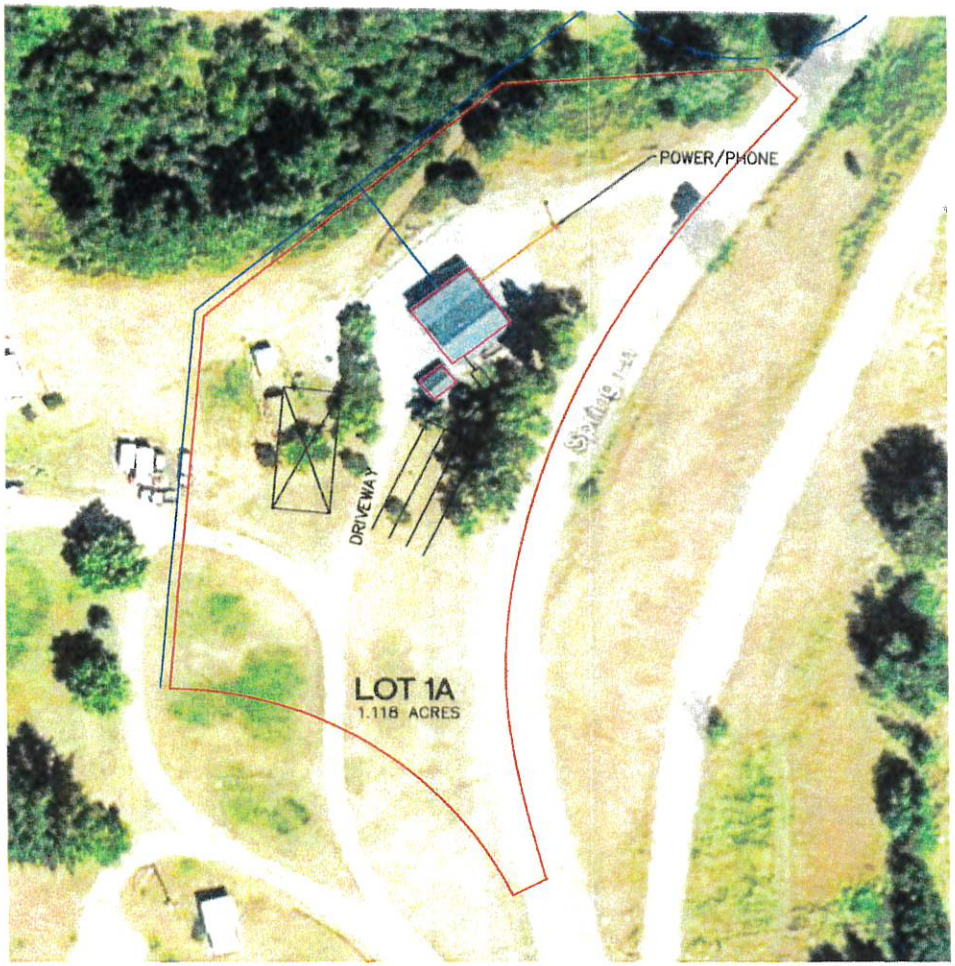

EDWARD GENEAU SITE MAP

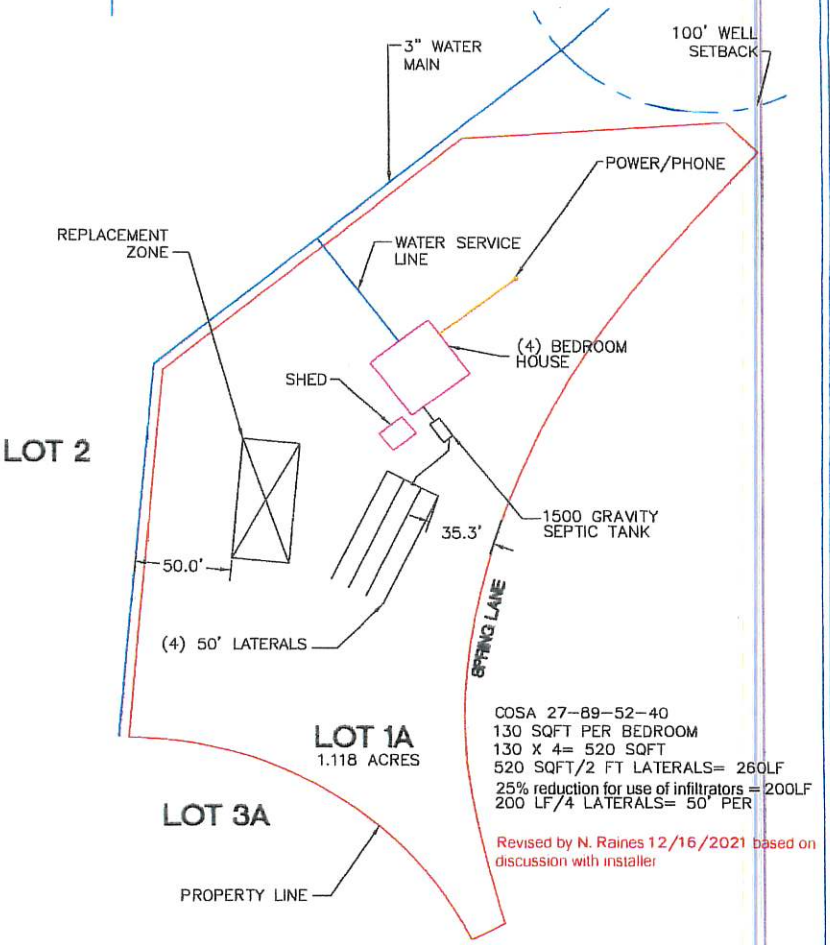

EDWARD GENEAU SITE MAP

		COMPANY: KEI	SCALE: 1/16 = 1 FOOT		KOOCANUSA EXCAVATING GENEAU SEPTIC REPLACEMENT	
		DRAWN BY:	DATE:	CHK'D BY:	SUBMISSION	12/15/21
		MORAN	12/2021		REVISION	12/15/21
		PLOT FILE:	SHEET:	FINISH:	DWG NO.	REV
		PML-0001	—		GEN-001	1

THIS DRAWING IS PROPERTY OF KEI LAND, CONSTRUCTION AND SHALL NOT BE REPRODUCED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

⑥ ⑤ ④ ③ ②