LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/13/2026 Expiration Date: 08/12/2027 Permit# 26-59801

Property Owner: Angela Morgan

Mailing Address: [redacted]

Installer: Sean McNamara License #: 221

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of pressure dosed system for 3 Bedroom House.

Legal: LITTLE COUNTRY ROAD PH 2, S01, T36 N, R27 W, LOT 5, ACRES 2.469, PM 7204

Property Address: 95 Grassy Loop, Eureka, MT 59917 Assessment Code: 59801

DEQ COSA: E.Q.# 11-1417 Little Country Rd Date: 12/20/2010

Approved Design Criteria: Installation of pressure dosed system for 3 Bedroom House with 2 Laterals @ 86' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 2 Length of Laterals: 86' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: **The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


REV	DESCRIPTION	BY/DATE	APVD/DATE

LOT 5

2.469 ACRES
95 GRASSY LOOP, EUREKA, MT 59917
S01, T36N, R27W, LITTLE COUNTRY RD PH 2, LOT 5, PM 7204
ASSESSMENT #0000059801
GEO 56-4823-01-1-01-28-0000
COSA #11-1417, DATE 12-2010

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.5 APP= 600 SQFT
600 SQ FT/3' CHAMBERS= 200 LF
REDUCTION FOR 0.5 APP= 15%
200' X 0.85= (2)-86' LATERALS
200' X 0.85= (3)-56' LATERALS

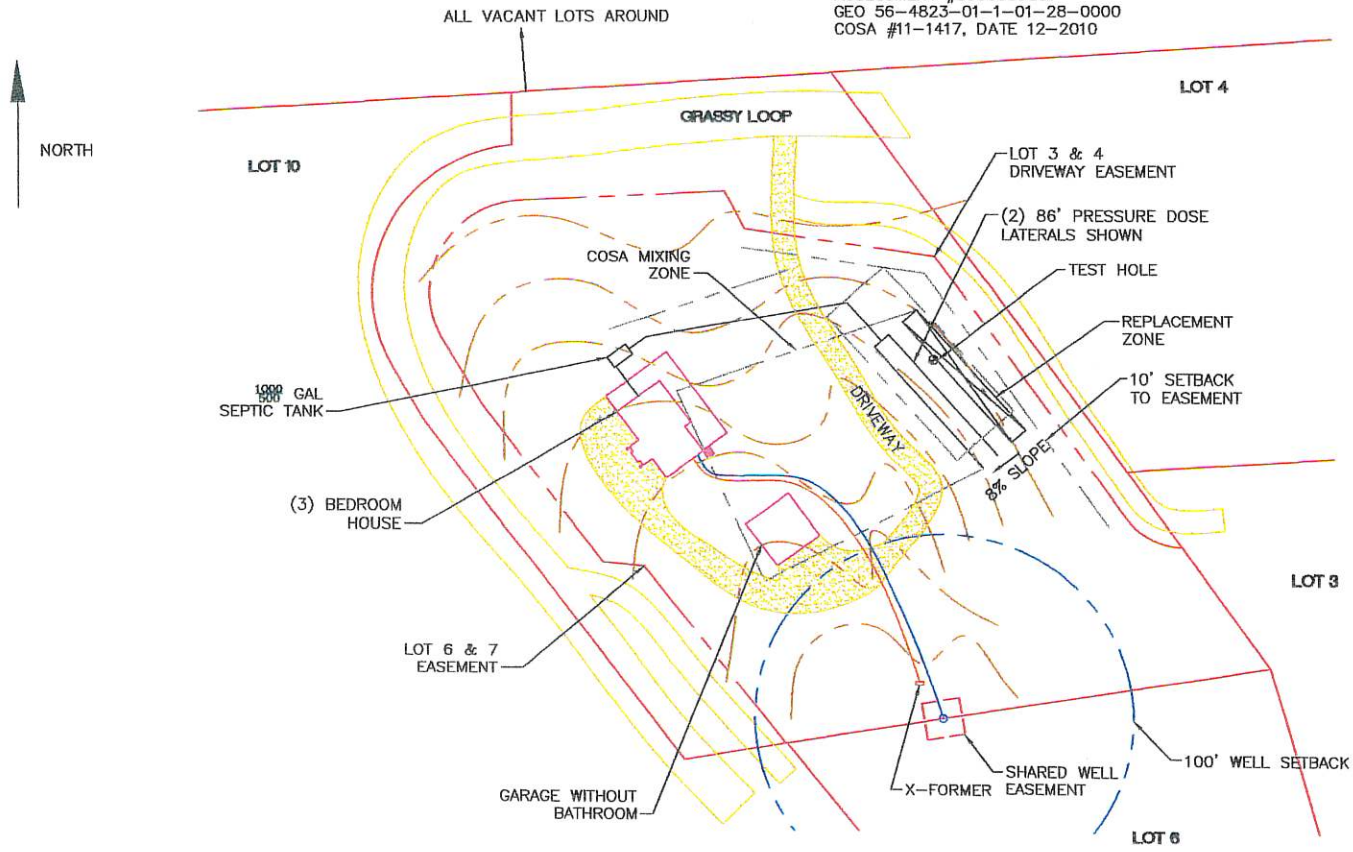

MORGAN SITE LAYOUT

REV	DATE	COMPANY	SCALE	KOOCANUSA EXCAVATING MORGAN SEPTIC
		KEI	1/16 & NOTED	SITE LAYOUT
		DESIGNED	DATE	8/22/25
		VERIFIED	4/2024	8/22/25
		PLOT FILE	WEIGHT	S. MORGAN 8/22/25
		PML-0001	—	374-001 1

THIS DRAWING IS PROPERTY OF KEI LAND, COMPANY. ANY USE WITHOUT WRITTEN PERMISSION IS A VIOLATION OF COPYRIGHT LAWS. IT CAN NOT BE REPRODUCED TO ANY OTHER PERSONS WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

⑥ ⑤ ④ ③ ②