LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/24/2026 Expiration Date: 06/23/2027 Permit#26-60251

Property Owner: Darwin Pluid

Mailing Address: [redacted]

Installer: Darwin Pluid License #: 164

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for commercial use with 300 GPD usage.

Parcel Description:

Legal: INDUSTRIAL APPROACH PARK, S23, T37 N, R27 W, LOT 3, ACRES 2, PM 7290

Property Address: 62 Gage Fox Way, Eureka, MT 59917 Assessment Code: 60251

DEQ COSA: E.Q.# 24-2166 Industrial Approach Park Date: 9/3/25

Approved Design Criteria: Installation of new pressure dosed system for commercial use with 300 GPD usage with 3 Laterals @ 45' with reduction given for chambers.

Commercial Use: 300 GPD Septic Tank Size: 1000/500 gallons Trench Width: 36"

# of Laterals: 3 Length of Laterals: 45' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

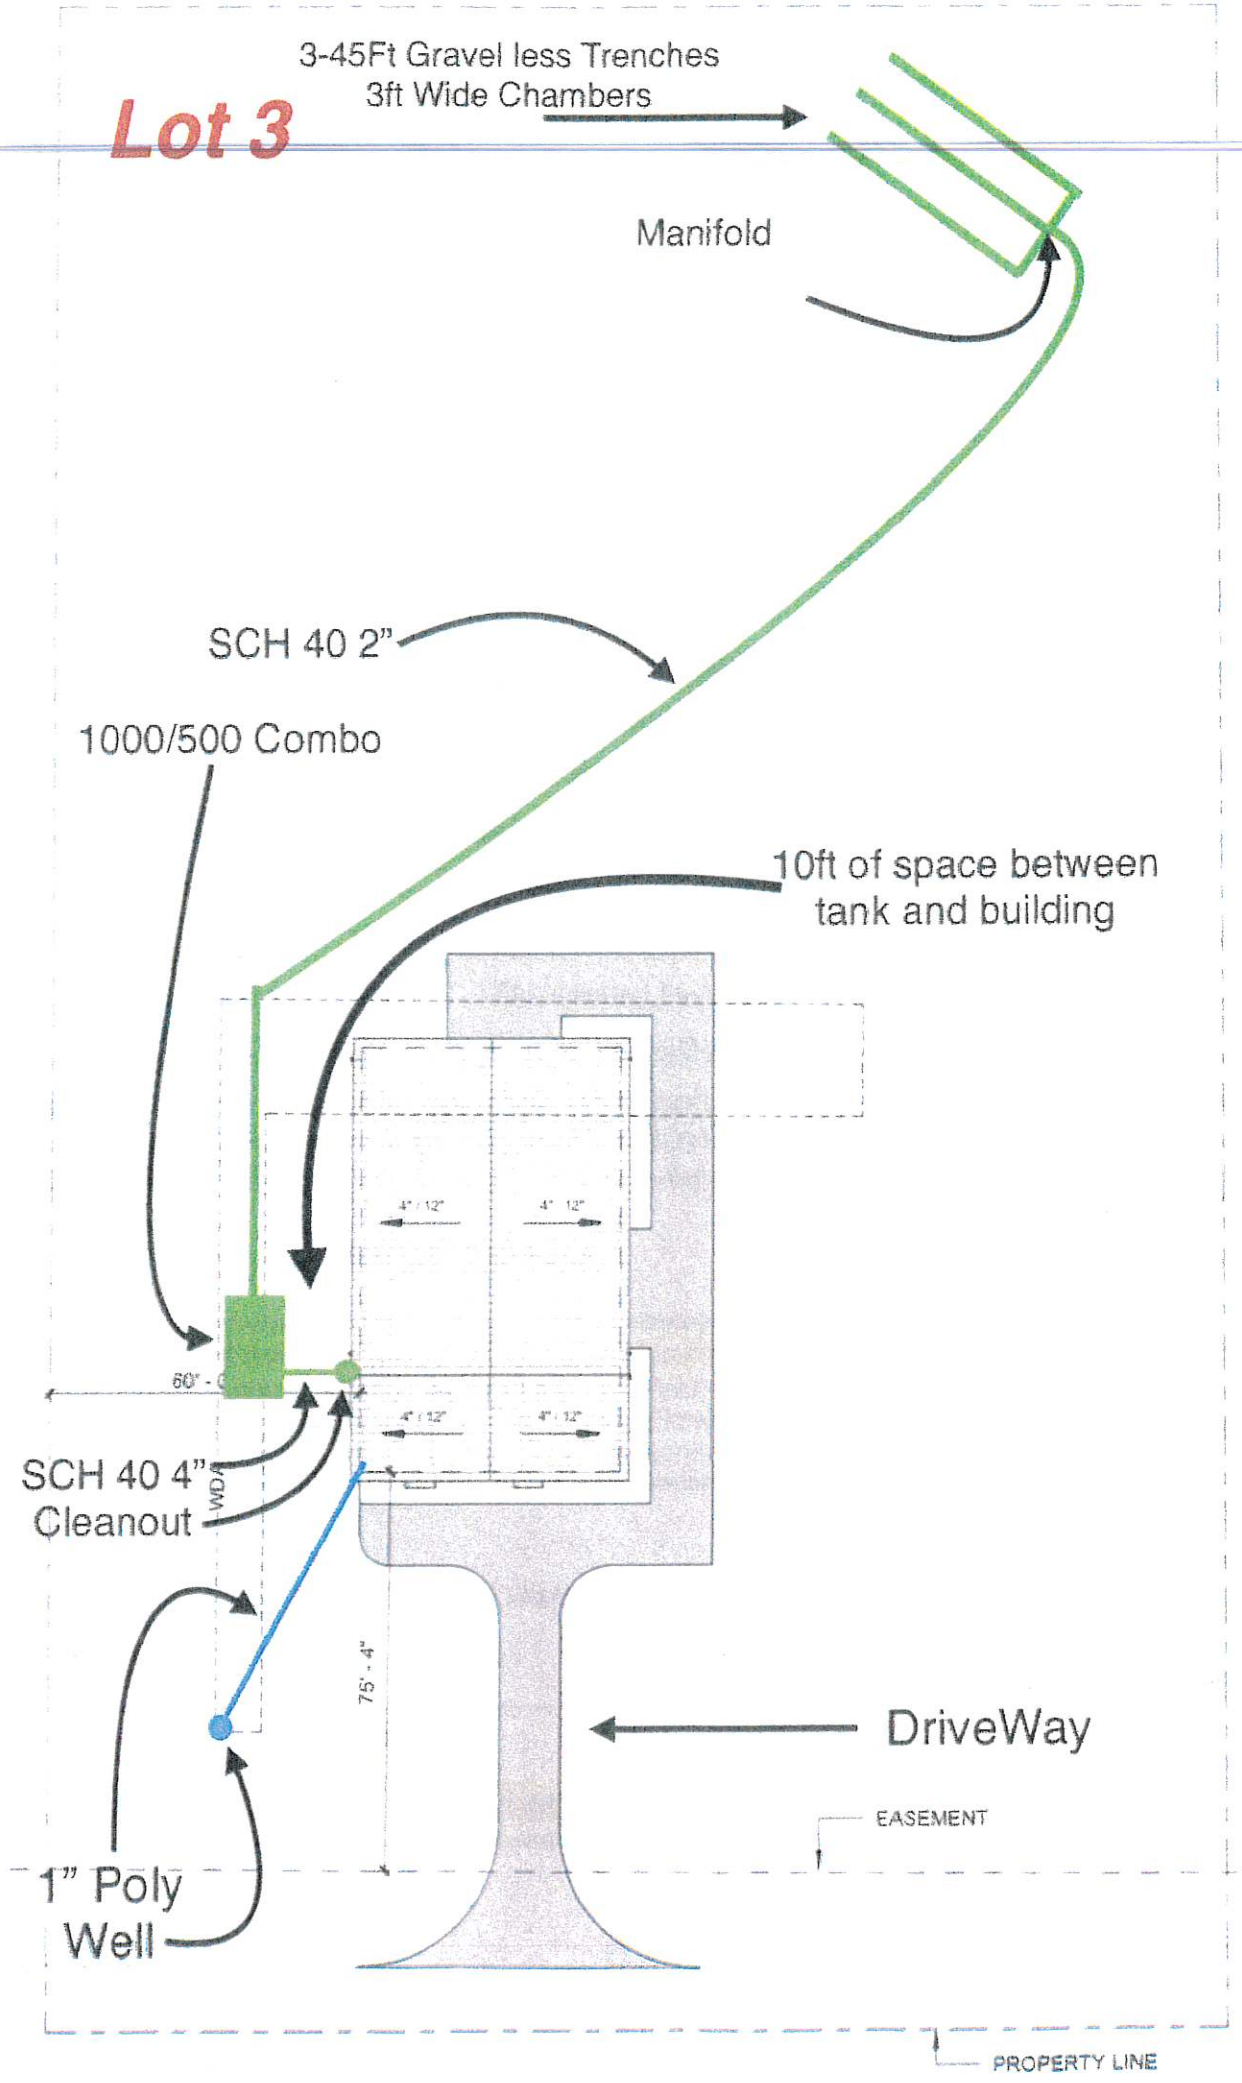
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Darwin Pluid *Date:* 7/22/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


Lot 3
3-45Ft Gravel less Trenches
3ft Wide Chambers
Manifold
SCH 40 2"
1000/500 Combo
10ft of space between
tank and building
SCH 40 4"
Cleanout
1" Poly
Well
75' - 4"
DriveWay
EASEMENT
PROPERTY LINE