LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/13/2026 Expiration Date: 01/12/2027 Permit#26-14788

Property Owner: Donovan Shultz

Mailing Address: [redacted]

Installer: Cory Burk License #: 213

Approved Work: (Check One) ☒ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 1 Bedroom House.

Legal: HIDDEN HILLS NORTH, S31, T36 N, R26 W, LOT 2, ACRES 6.042, PF#5655

Property Address: 3056 Tobacco Road, Eureka, MT 59917 Assessment Code: 14788

DEQ COSA: E.Q.# 96-2107 Hidden Hills North Date: 12/19/25 RLL

Approved Design Criteria: Installation of new gravity system for 1 Bedroom House with 2 Laterals @ 40'.

# of Bedrooms: 1 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 40' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/29/26


This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Stolin Blmly R.S. 12/19/25
Local Reviewer Date

Accepted under contract
NA
DEQ Representative Date

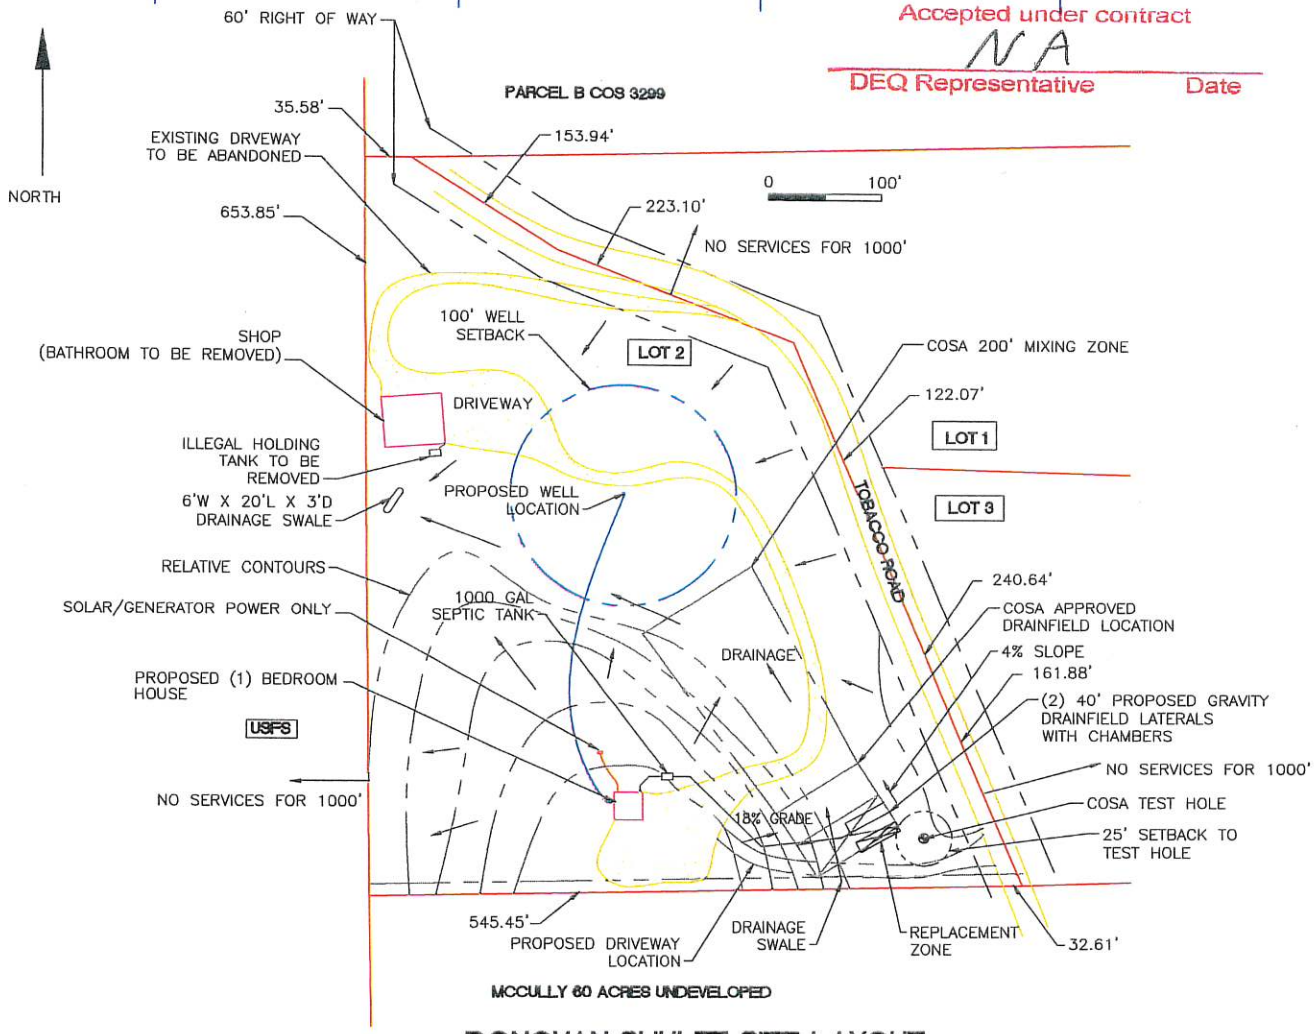

DONOVAN SHULTZ SITE LAYOUT

FILL FOR LOT 2 HIDDEN HILLS NORTH

REV	DESCRIPTION	BY/DATE	APRD/DATE

DRAINFIELD SIZING

COSA= 160 SQFT/BEDROOM
160 SQFT/ 2' CHAMBERS= 80 LF
80 LF– (2) 40' LATERALS

LOT 2

6.042 ACRES
3056 TOBACCO ROAD, EUREKA, MT 59917
S31, T36N, R26W, HIDDEN HILLS NORTH
ASSESSMENT #0000014788
GEO 56–4824–31–1–02–11–0000
COSA #96–2107, DATED 2–1996

REV'L DATE	COMPANY	SCALE	ALL IN EXCAVATION SHULTZ SEPTIC
	MDS	1/16 & NOTED	SITE LAYOUT
	CONTRACT: VERBAL	DATE: 11/2023	DRAWN: 11/12/25
	PLOT FILE: PML-0001	WEIGHT:	CHECKED: 11/17/25
		FINISH:	DWG NO: 459-001

THIS DRAWING IS PROPERTY OF MDS UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & MDS IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM MDS MANAGEMENT