LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/13/2026 Expiration Date: 08/12//2027 Permit# 26-15445

Property Owner: Gene Sprague

Mailing Address: [redacted]

Installer: Homeowner License #:

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system for 3 Bedroom House.

Parcel Description:

Legal: S13, T30 N, R30 W, COS 5079, PARCEL A, ACRES 60.6

Property Address: 11709 MT Hwy 37 Libby, MT 59935 Assessment Code: 15445

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of gravity system for 3 Bedroom House with 2 Laterals @ 70.'

# of Bedrooms: 3	Septic Tank Size: 1000	Trench Width: 24"
# of Laterals: 2	Length of Laterals: 70'	Trench Depth: 24"- 36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, R.S.*

NOTICE: **The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

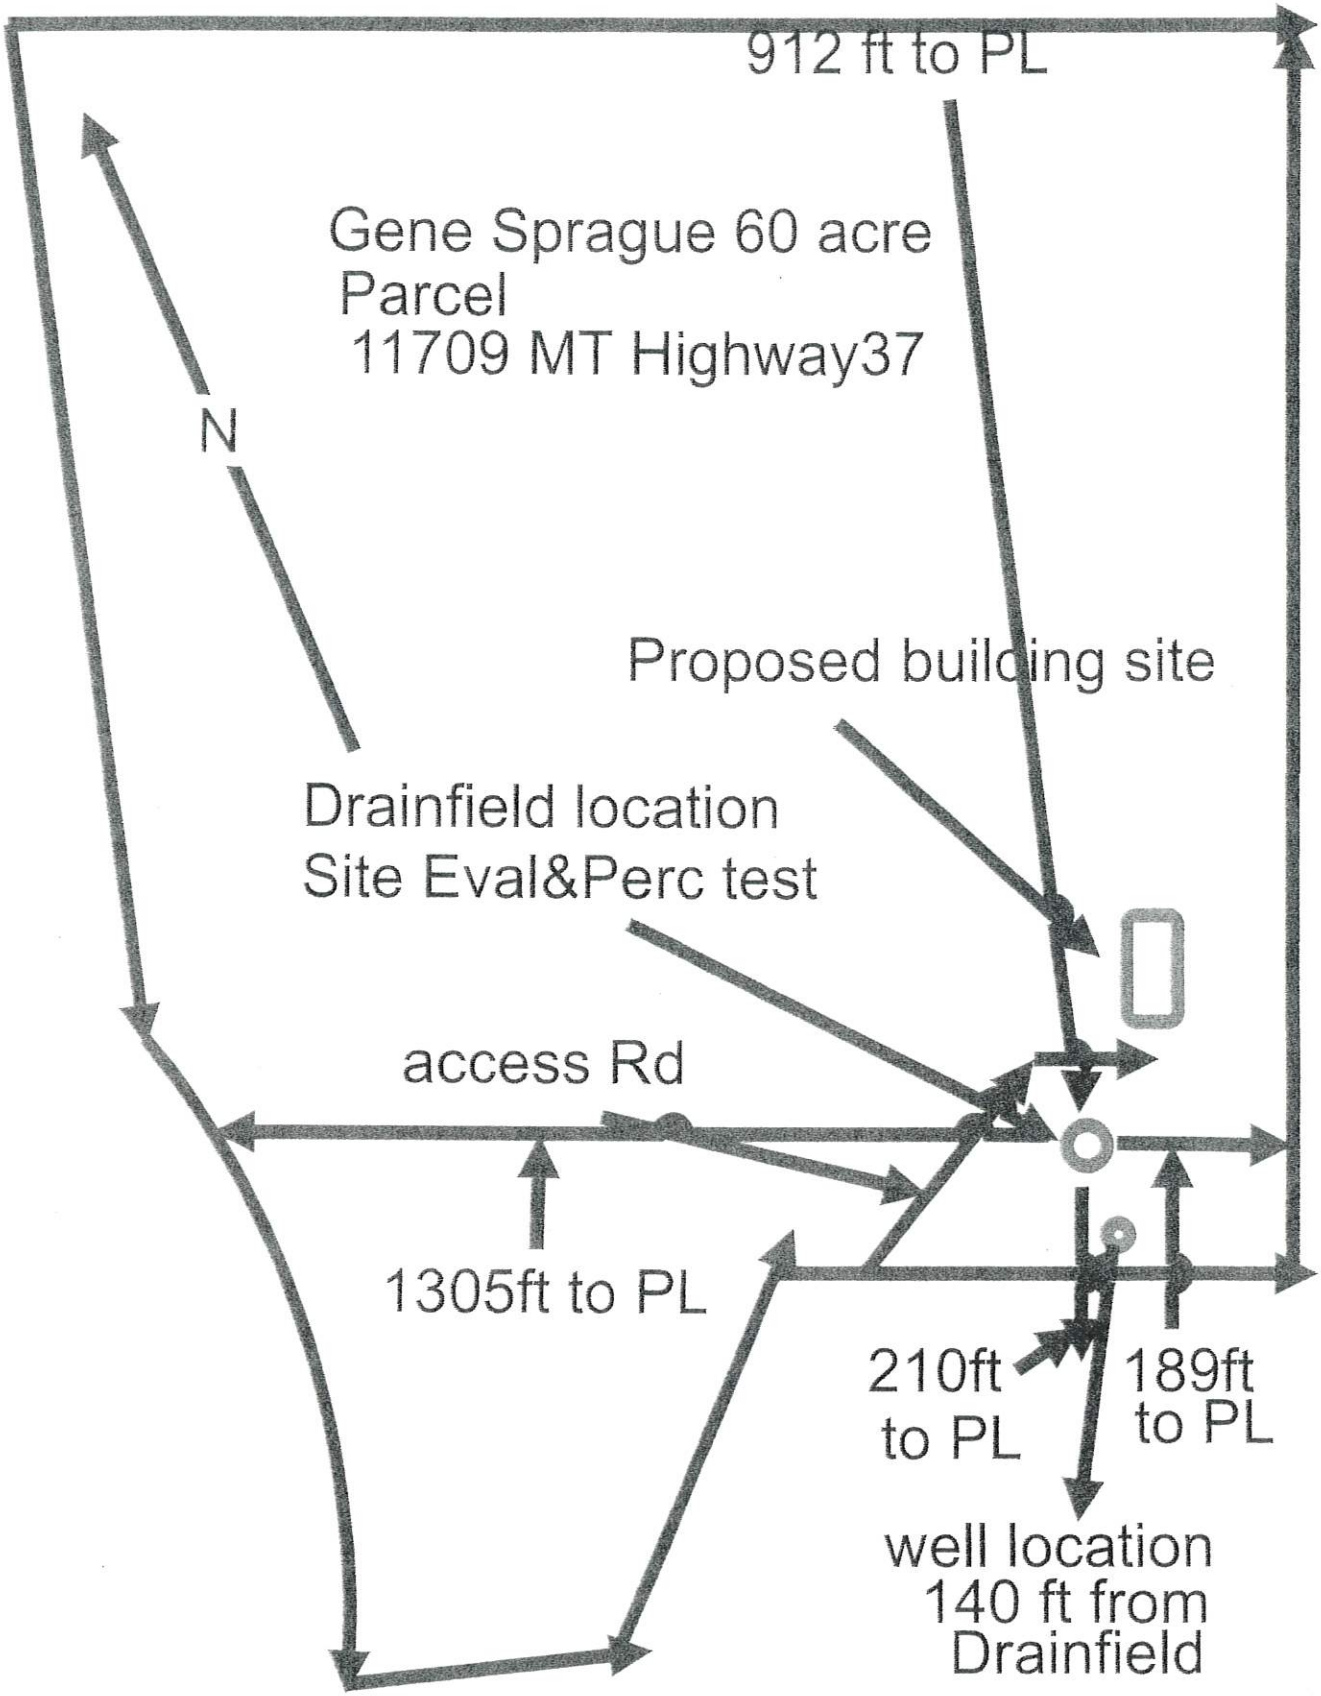
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


912 ft to PL
Gene Sprague 60 acre
Parcel
11709 MT Highway37
N
Proposed building site
Drainfield location
Site Eval&Perc test
access Rd
1305ft to PL
210ft
to PL
189ft
to PL
well location
140 ft from
Drainfield