LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/14/2025 Expiration Date: 08/13/2026 Permit#25-5793

Property Owner: Brian Thomas

Mailing Address: [redacted]

Installer: Jeremy Thomas License #: 220

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: S28, T30 N, R33 W, ACRES 20, N2NWNW OR TRACT 1B

Property Address: 760 Hamaoka Dr., Troy, MT 59935 Assessment Code: 5793

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with 3 Laterals @ 100'.

# of Bedrooms: 3 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 3 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

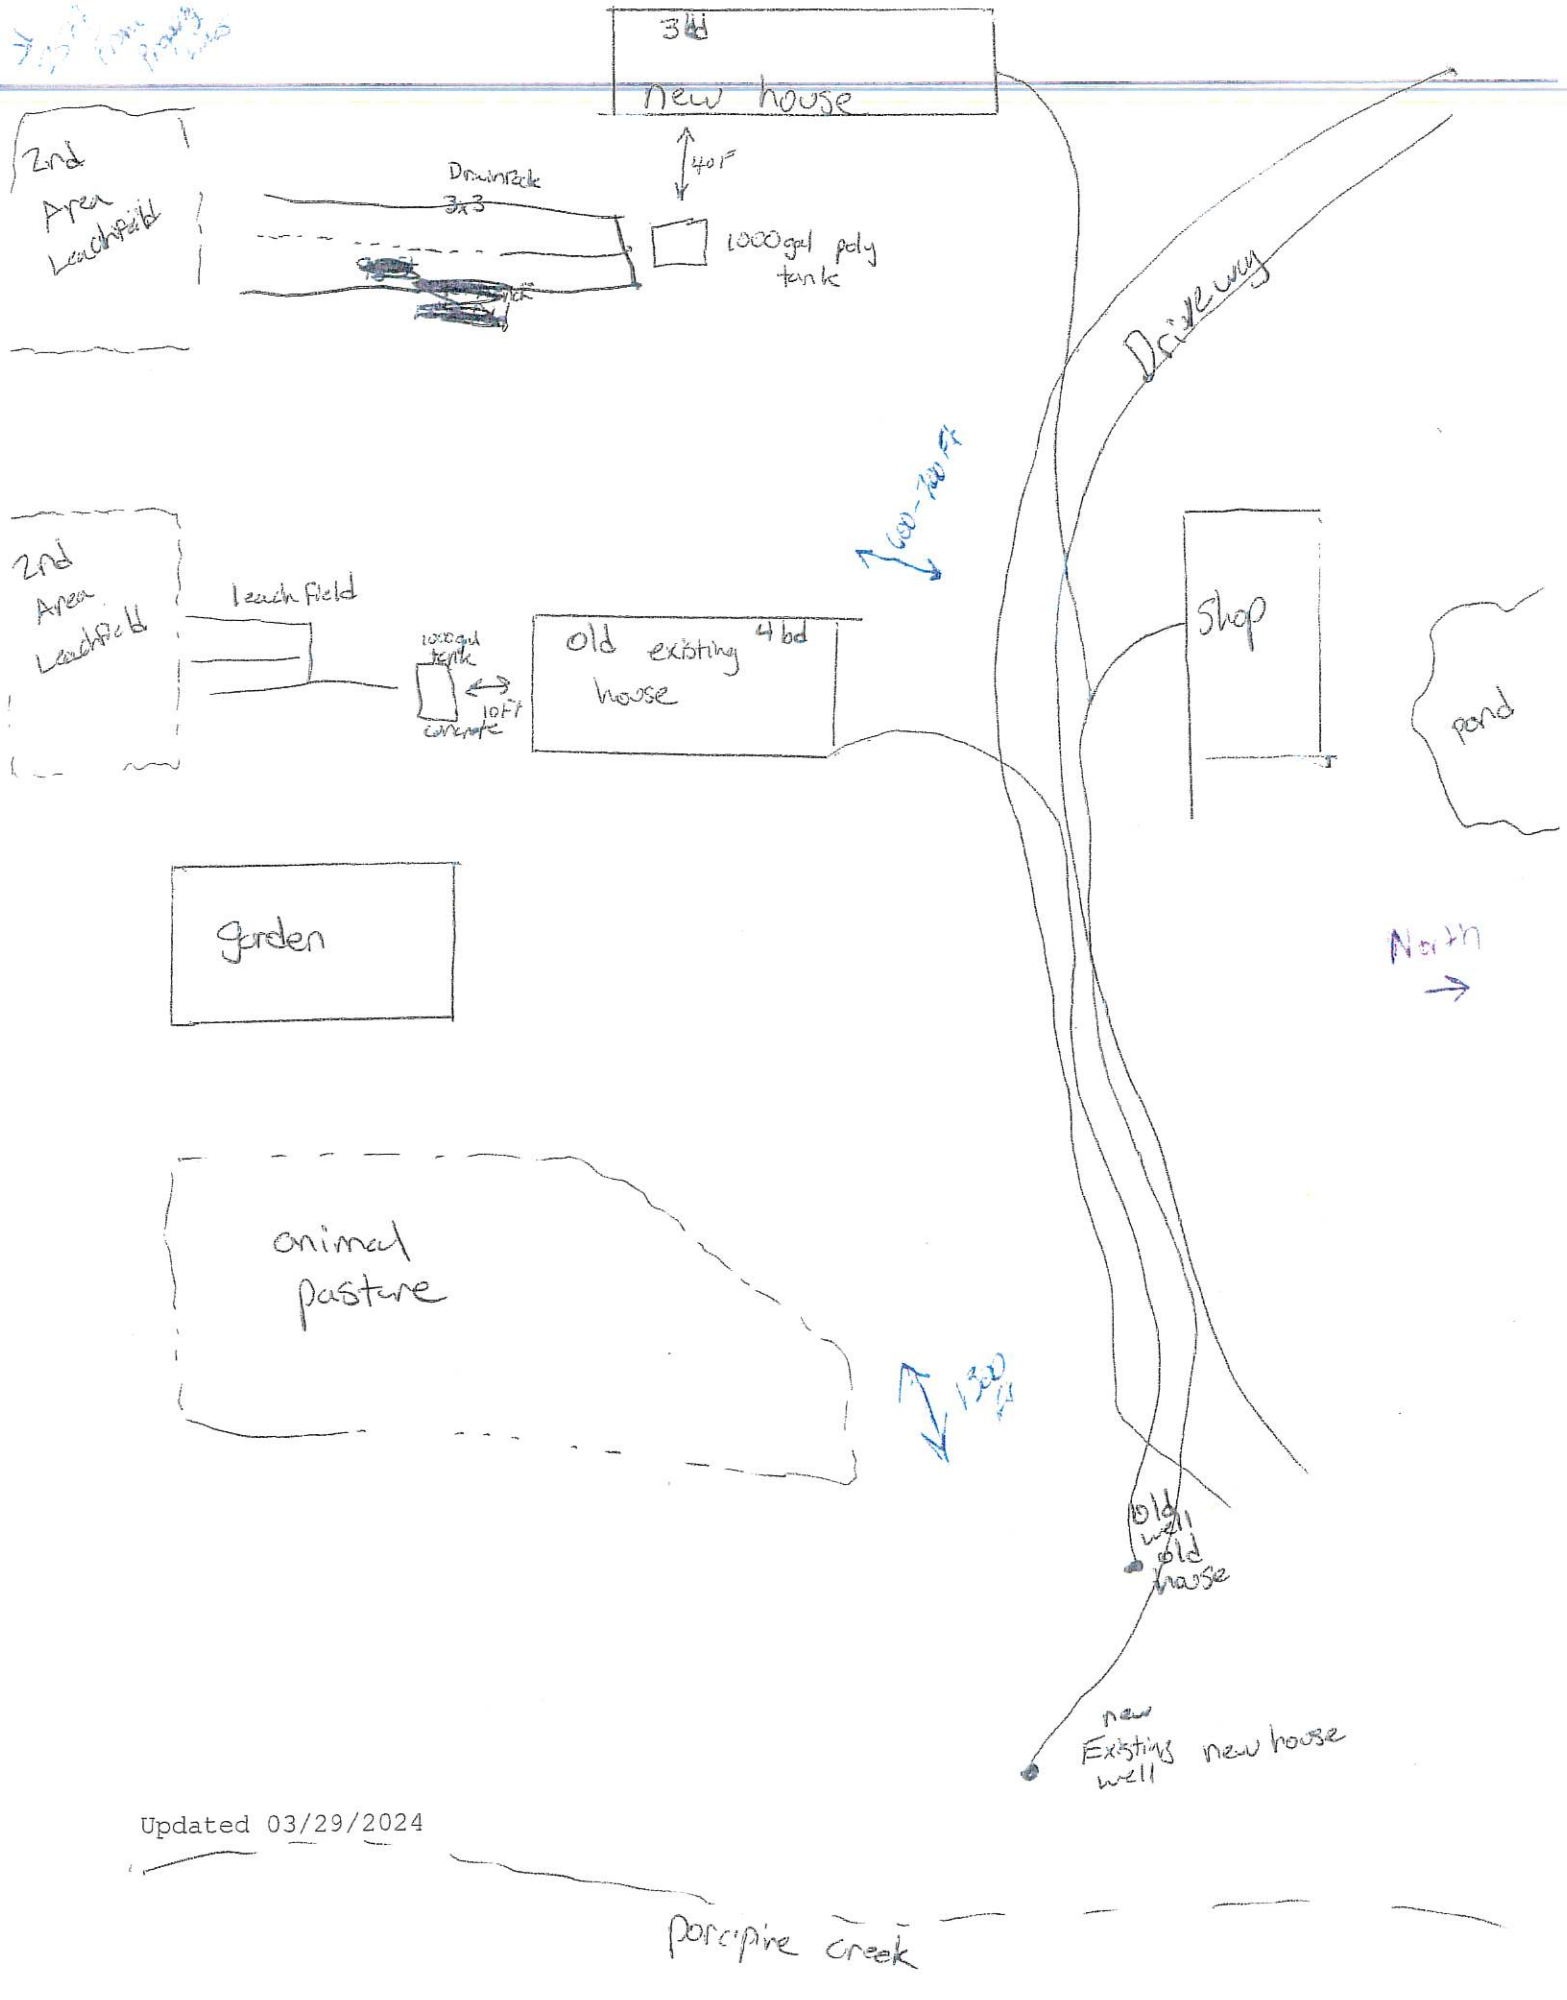
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/27/26

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SV


3 bd
new house
40'
2nd Area Leachfield
Drainrock 3x3
1000gal poly tank
Driveway
60-70'
2nd Area Leachfield
Leach field
1000gal tank
10FT
concrete
old existing 4 bd house
Shop
pond
garden
North
animal pasture
132'
old well old house
new Existing well
new house
Updated 03/29/2024
Porcupine Creek