# LINCOLN COUNTY HEALTH DEPARTMENT
# ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/21/2026 Expiration Date: 01/20/2027 Permit# 26-55848

Property Owner: Susane and Matthew Turner

Mailing Address: [redacted]

Installer: Elmer Brenneman License #: 170

*Approved Work:* (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House.

Legal: CIELO LINDO ESTATES 2, S18, T36 N, R26 W, LOT 4A, ACRES 5.41, CS 4226

Property Address: Via Cielo Lindo Rd Lot 4 Assessment Code: 55848

DEQ COSA: E.Q.# Pending Date:

*Approved Design Criteria:* Installation of new gravity system for 3 Bedroom House with 4 Laterals @ 85' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 85' Trench Depth: 24"-36"

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!**

*Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.*

**Issued By:** *Robin Blumberg, RS*

NOTICE: **The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

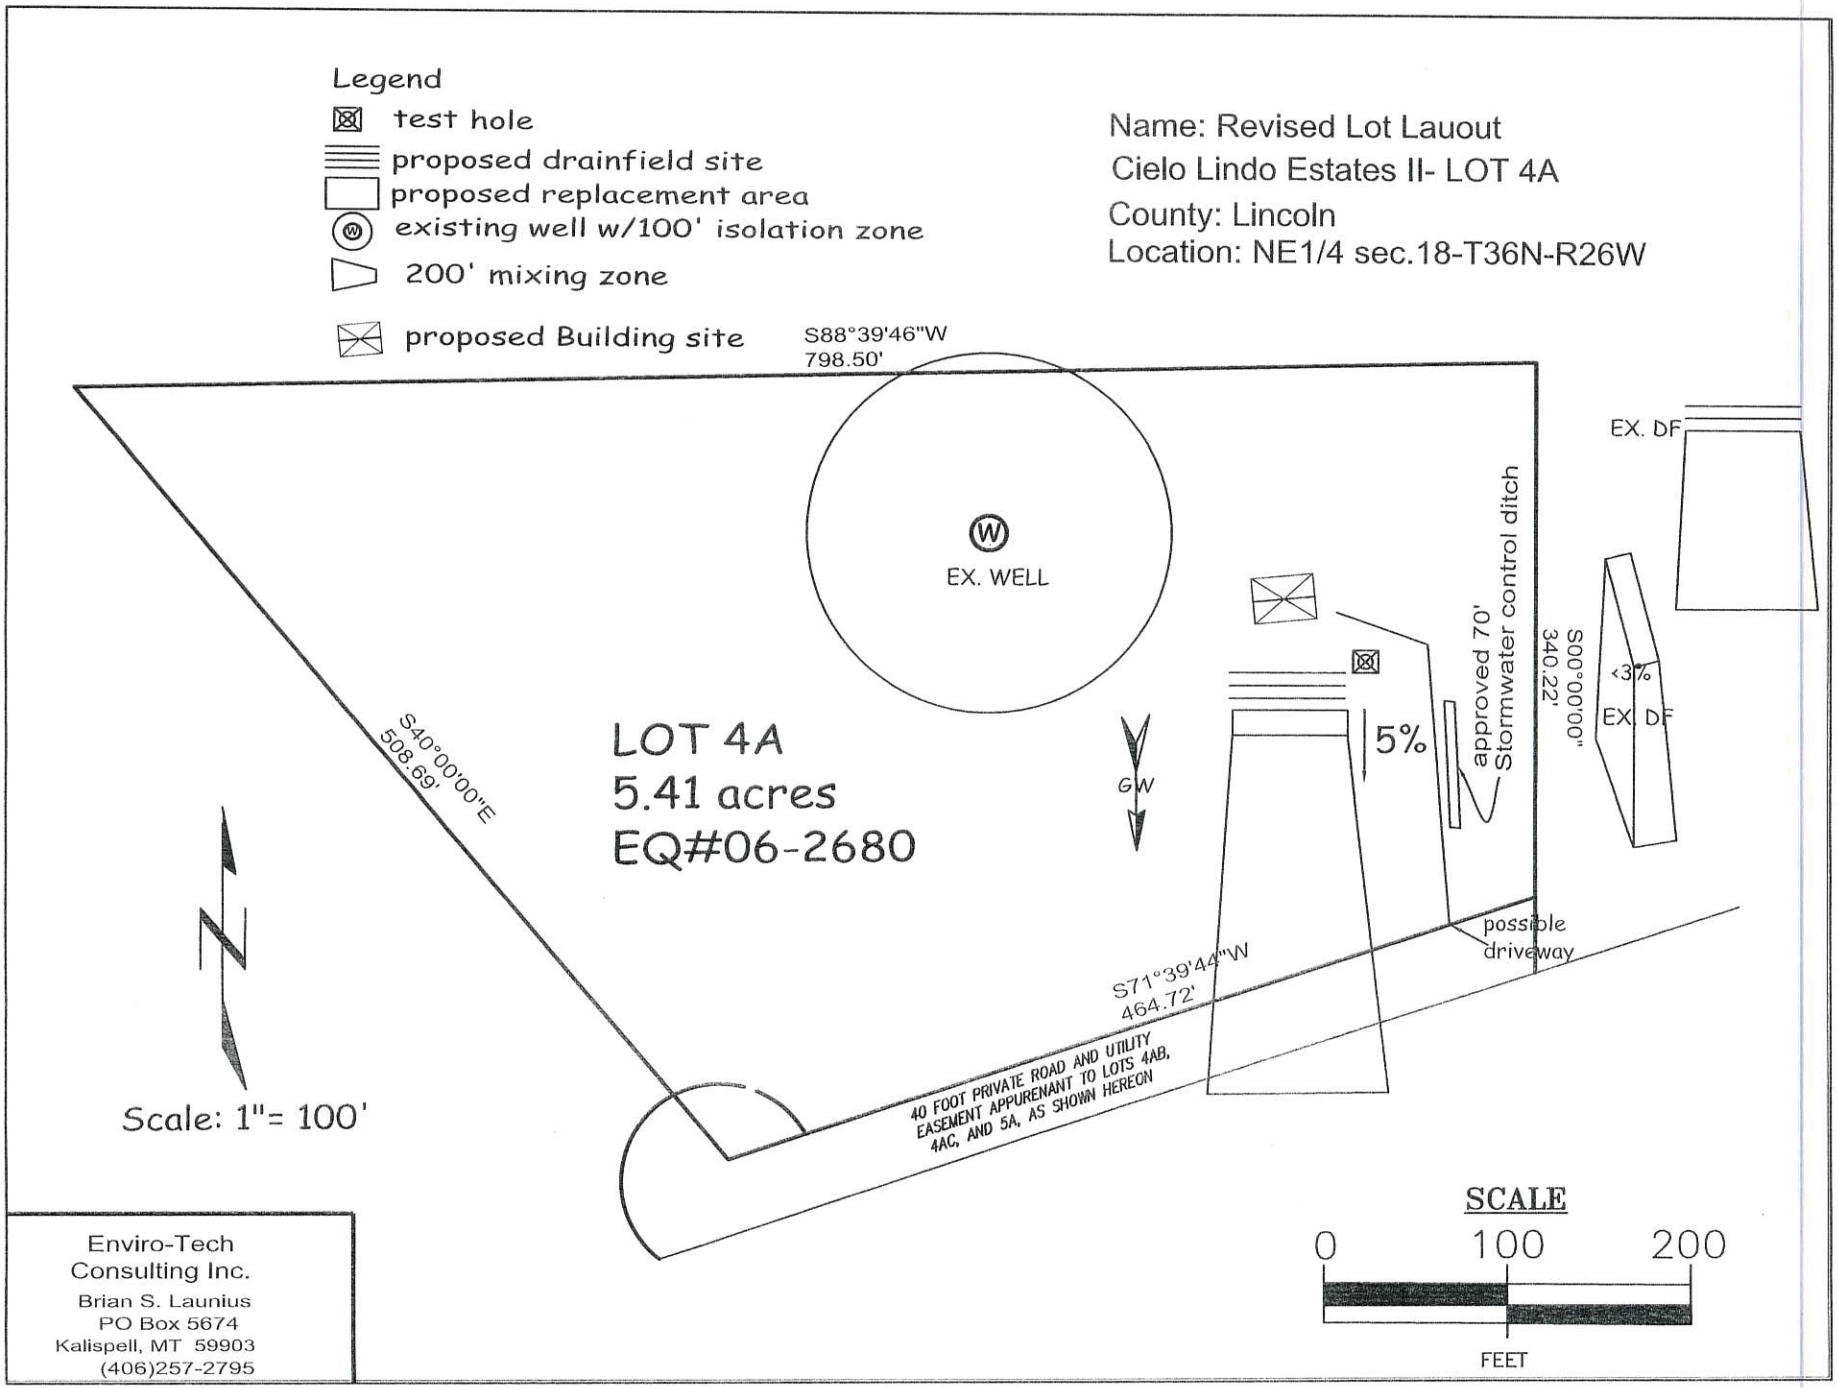
Closure Statement:

*This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

*Signed:* Robin Blumberg *Date:* 8/17/26

***This permit is not finalized until the system is inspected and the closure statement is signed.***

***This permit is not a guarantee that the system will function properly for a prescribed period of time.***


Legend
test hole
proposed drainfield site
proposed replacement area
existing well w/100' isolation zone
200' mixing zone
proposed Building site
Name: Revised Lot Lauout
Cielo Lindo Estates II- LOT 4A
County: Lincoln
Location: NE1/4 sec.18-T36N-R26W
S88°39'46"W
798.50'
EX. WELL
EX. DF
approved 70' Stormwater control ditch
S00°00'00"
340.22'
<3%
EX. DF
LOT 4A
5.41 acres
EQ#06-2680
GW
5%
S40°00'00"E
508.69'
possible driveway
S71°39'44"W
464.72'
40 FOOT PRIVATE ROAD AND UTILITY EASEMENT APPURENANT TO LOTS 4AB, 4AC, AND 5A, AS SHOWN HEREON
N
Scale: 1"= 100'
SCALE
0
100
200
FEET
Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795