LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/052026 Expiration Date: 06/04/2027 Permit#26-53599

Property Owner: Jeffery Arnold

Mailing Address: [redacted]

Installer: Bill Avants License #: 121

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: BOTHMAN 2, S29, T31 N, R31 W, ACRES 2.35, LOT 5 PM 6491

Property Address: 40 Thede Rd., Troy, MT 59935 Assessment Code: 53599

DEQ COSA: E.Q.# 03-1672 Bothman #2 Date:6/13/2003

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 80'.

# of Bedrooms: 3	Septic Tank Size: 1000/500	Trench Width: 36"
# of Laterals: 3	Length of Laterals: 80'	Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/4/26


This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Marquardt & Marquardt Surveying
Kalispell, Mt

name- Bothman Subdivision #2
county- Lincoln
location- NW¼SW1/4sec.29-T31N-R21W
E½ sec. 30
drawn by-Brian S. Launius
E.Q.# 03-1672

APPROVED
Montana Department of Environmental Quality
Permitting and Compliance Division
Tim Read 6-13-2003
Reviewer Date

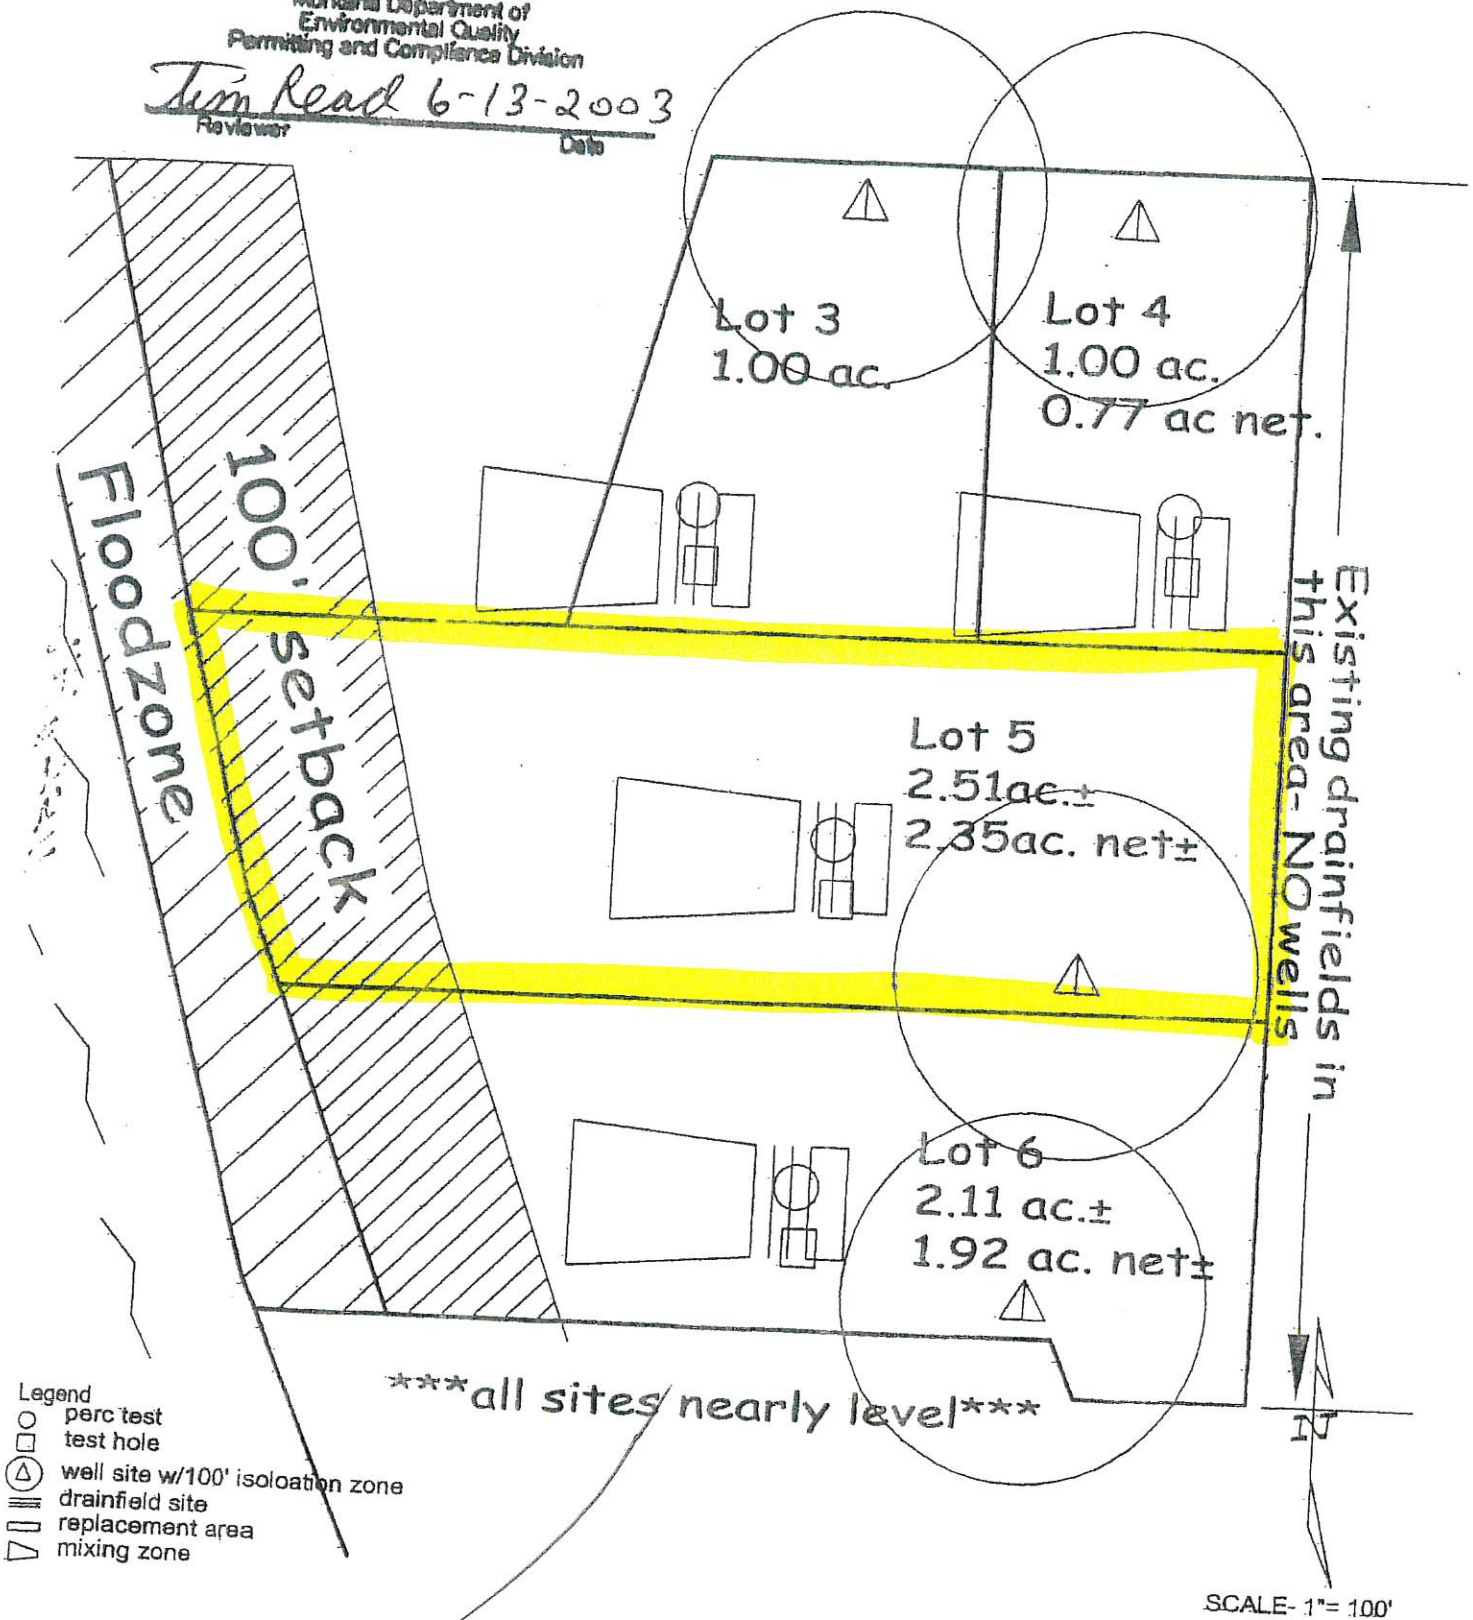

Legend
- perc test
- test hole
- well site w/100' isoloation zone
- drainfield site
- replacement area
- mixing zone

SCALE- 1"= 100'