LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/31/2026 Expiration Date: 07/30/2027 Permit#26-1614

Property Owner: Damon Maitland

Mailing Address: [redacted]

Installer: Homeowner License #:

Approved Work: (Check One) ☒ New Installation ☒ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of gravity system for 3 Bedroom House.

Legal: S30, T34 N, R26 W, COS 3527, ACRES 6.706

Property Address: 6580 Edna Creek Rd., Trego, MT 59934 Assessment Code: 1614

DEQ COSA: E.Q.# 06-1992 RLL Tract 1 Date:7/28/26

Approved Design Criteria: Installation of gravity system for 3 Bedroom House with 4 Laterals @ 65' with reduction for chambers.

# of Bedrooms: 3 Septic Tank Size: 1500 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: **The Department must be notified at least 3 business days (72 hours) prior to backfilling the system.** Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/3/26

This permit is not finalized until the system is inspected and the closure statement is signed.


This permit is not a guarantee that the system will function properly for a prescribed period of time.

AREA = 6.706 ACRES

EQ # 06-1992

STORM WATER, WATER AND SEWER LAYOUT

SECTION 30, TOWNSHIP 34N, RANGE 26W, SW 1/4 PRINCIPAL MERIDIAN, MONTANA, LINCOLN COUNTY

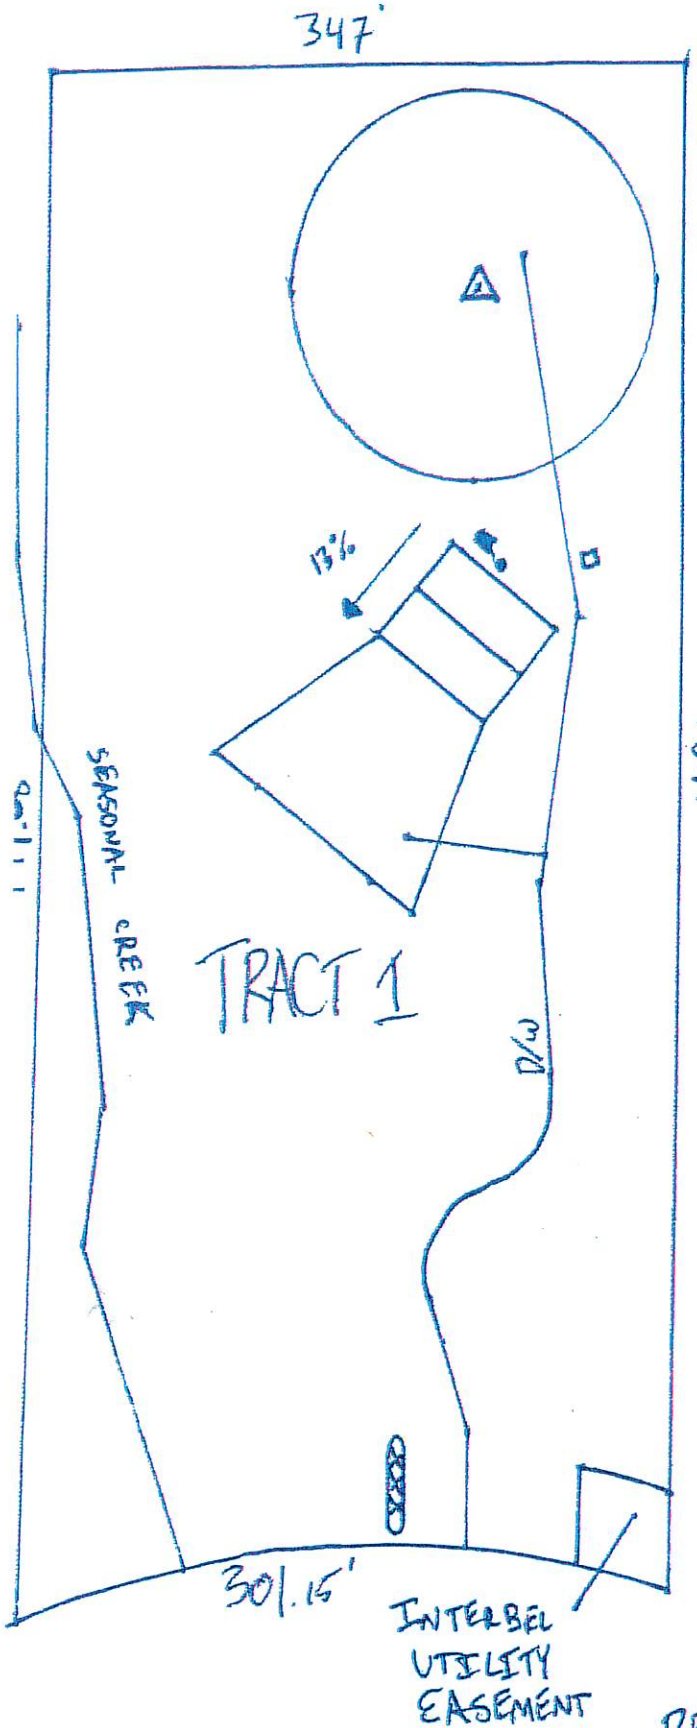

LEGEND

- ELECTRICITY METER
- EXISTING WELL W/ 100' RADIUS
- PERCOLATION TEST
- TEST HOLE
- SLOPE DIRECTION AND %
- PROPOSED DRAINFIELD/ REPLACEME WITH MIXING ZONE
- STORM WATER INFILTRATION AREA

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

Robin Blumley R.S. 7/28/26
Local Reviewer Date

Accepted under contract

NA
DEQ Representative Date

N

100' = 1"

PREPARED BY OWNER DAMON MAITLAND